



## Civil & Structural Engineering Design Services Pty. Ltd.

**Client:** Extreme Marquees

**Project:** Design check – 9m × 9m Function Crest Standard Tent Structure for 80km/hr  
– 8m × 9m Function Crest Standard Tent Structure for 80km/hr  
– 6m × 9m Function Crest Standard Tent Structure for 80km/hr

**Reference:** Extreme Marquees' data

Report by: KZ  
Checked by: EAB  
Date: 11/06/2015

JOB NO: D-11-263557-3



## *Table of Contents*

|          |                                                                                        |           |
|----------|----------------------------------------------------------------------------------------|-----------|
| <b>1</b> | <b>Introduction .....</b>                                                              | <b>3</b>  |
| <b>2</b> | <b>Design Restrictions and Limitations.....</b>                                        | <b>4</b>  |
| <b>3</b> | <b>Specifications.....</b>                                                             | <b>5</b>  |
| 3.1      | General.....                                                                           | 5         |
| 3.2      | Aluminium Properties.....                                                              | 6         |
| 3.3      | Buckling Constants.....                                                                | 6         |
| 3.4      | Section Properties.....                                                                | 7         |
| <b>4</b> | <b>Design Loads .....</b>                                                              | <b>7</b>  |
| 4.1      | Ultimate .....                                                                         | 7         |
| 4.2      | Load Combinations.....                                                                 | 7         |
| 4.2.1    | Serviceability .....                                                                   | 7         |
| 4.2.2    | Ultimate.....                                                                          | 7         |
| <b>5</b> | <b>Wind Analysis .....</b>                                                             | <b>8</b>  |
| 5.1      | Parameters & Coefficients ( $C_{fig}$ ) .....                                          | 8         |
| 5.2      | Pressure (P) .....                                                                     | 16        |
| 5.2.1    | Pressure summary.....                                                                  | 16        |
| 5.3      | Wind Load Diagrams.....                                                                | 17        |
| 5.3.1    | Wind 1(case 1) .....                                                                   | 17        |
| 5.3.2    | Wind 1(case 2) .....                                                                   | 17        |
| 5.3.3    | Wind 2(Case1) .....                                                                    | 18        |
| 5.3.4    | Wind 2(case 2) .....                                                                   | 18        |
| 5.3.5    | Max Bending Moment due to critical load combination in major axis.....                 | 19        |
| 5.3.6    | Max Bending Moment in minor axis due to critical load combination.....                 | 19        |
| 5.3.7    | Max Shear in due to critical load combination.....                                     | 20        |
| 5.3.8    | Max Axial force in upright support and roof beam due to critical load combination..... | 20        |
| 5.3.9    | Max reactions.....                                                                     | 21        |
| 5.3.10   | Summary Table: .....                                                                   | 21        |
| <b>6</b> | <b>Checking Members Based on AS1664.1 ALUMINIUM LSD .....</b>                          | <b>22</b> |
| 6.1      | Upright Supports .....                                                                 | 22        |
| 6.2      | Rafter .....                                                                           | 25        |
| 6.3      | Gable Pole .....                                                                       | 28        |
| 6.4      | Ridge & Eave Purlin.....                                                               | 31        |
| 6.5      | Gable Beam.....                                                                        | 35        |
| 6.6      | Intermediate Purlin.....                                                               | 38        |
| 6.7      | Cross Brace.....                                                                       | 41        |
| <b>7</b> | <b>Summary.....</b>                                                                    | <b>45</b> |
| 7.1      | Conclusions.....                                                                       | 45        |
| <b>8</b> | <b>Appendix A – 9m x 9m Function Crest Tent.....</b>                                   | <b>46</b> |



## Civil & Structural Engineering Design Services Pty. Ltd.

### 1 Introduction

This 'Certification' is the sole property for copyright to Mr. Ted Bennett of Civil & Structural Engineering Design Services Pty. Ltd.

The report examines the effect of 3s gust wind of 80 km/hr on 9m Span x 3m Bay Function Crest Standard Tent. The relevant Australian Standards AS1170.0:2002 General principles, AS1170.1:2002 Permanent, imposed and other actions and AS1170.2:2011 Wind actions are used. The design check is in accordance with AS/NZS 1664.1:1997 Aluminum limit state design.



## **2 Design Restrictions and Limitations**

- 2.1 The erected structure is for temporary use only and is limited to 6 months maximum at any one site establishment.
- 2.2 It should be noted that if high gust wind speeds are anticipated or forecast in the locality of the tent, the temporary erected structure should be dismantled.
- 2.3 For forecast winds in excess of **(refer to summary)** – all fabric shall be removed from the frames, and the structure should be completely dismantled.
- (Please note that the locality squall or gust wind speed is affected by factors such as terrain exposure and site elevations.)
- 2.4 The structure may only be erected in regions with wind classifications no greater than the limits specified on the attached wind analysis.
- 2.5 The wind classifications are based upon category 2 in AS. Considerations have also been made to the regional wind terrain category, topographical location and site shielding from adjacent structures. Please note that in many instances topographical factors such as a location on the crest of a hill or on top of an escarpment may yield a higher wind speed classification than that derived for a higher wind terrain category in a level topographical region. For this reason, particular regard shall be paid to the topographical location of the structure. For localities which do not conform to the standard prescribed descriptions for wind classes as defined above, a qualified Structural Engineer may be employed to determine an appropriate wind class for that the particular site.
- 2.6 The structures in no circumstances shall ever be erected in tropical or severe tropical cyclonic condition.
- 2.7 The tent structure has not been designed to withstand snow and ice loadings such as when erected in alpine regions.
- 2.8 For the projects, where the site conditions approach the design limits, extra consideration should be given to pullout tests of the stakes and professional assessment of the appropriate wind classification for the site.
- 2.9 Wall Bracing and roof bracing are required at each end bay and every third bay in between to resist against lateral movement due to wind direction<sup>2</sup> for multiple tent length.**




### 3 Specifications

#### 3.1 General

| Tent category |                  |
|---------------|------------------|
| Material      | Aluminum 6061-T6 |

| Size    | Model                   |
|---------|-------------------------|
| 9m x 9m | Function Crest Standard |

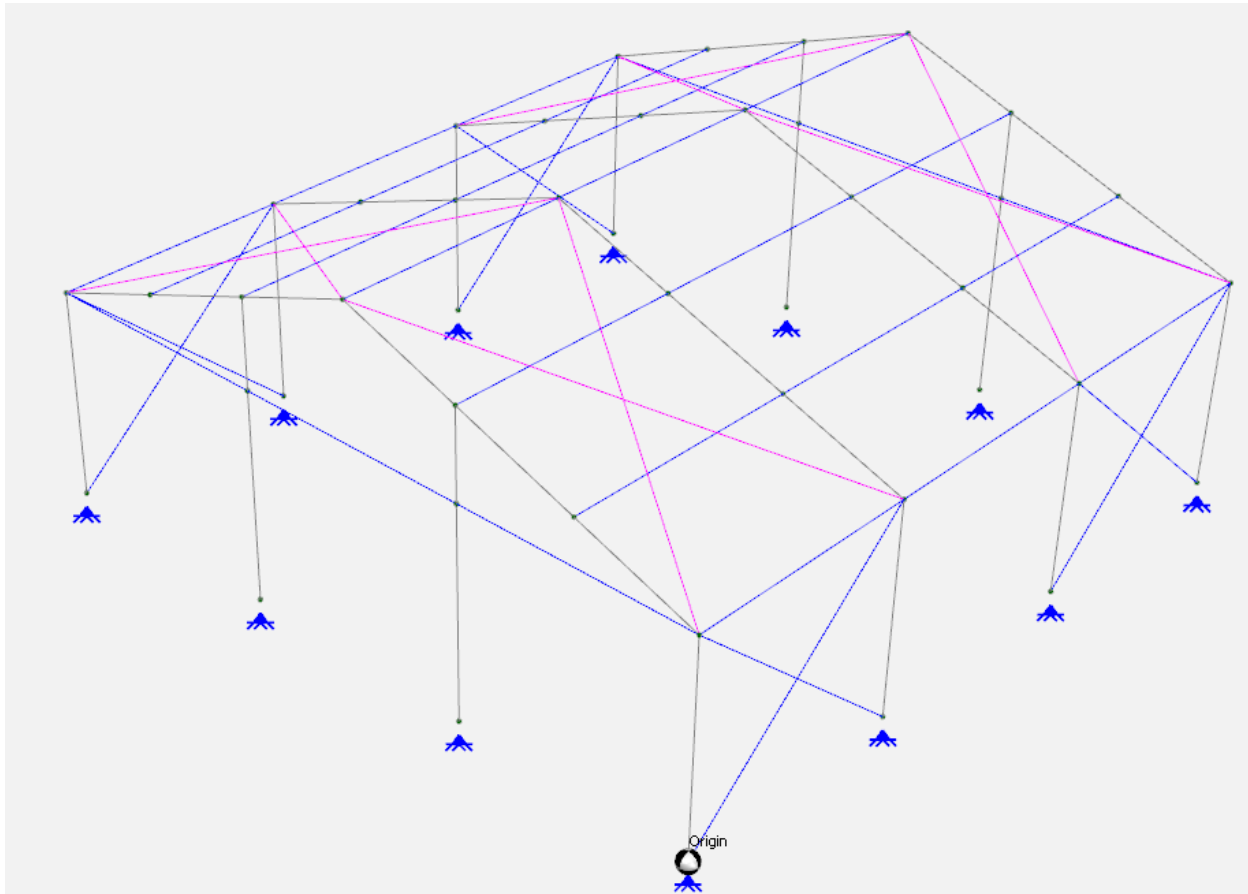



## Civil & Structural Engineering Design Services Pty. Ltd.

### 3.2 Aluminium Properties

| Aluminium Properties                       |             |           |
|--------------------------------------------|-------------|-----------|
| Compressive yield strength                 | Fcy         | 241 MPa   |
| Tensile yeild strength                     | Fty         | 241 MPa   |
| Tensile ultimate strength                  | Ftu         | 262 MPa   |
| Shear yield strength                       | Fsy         | 138 MPa   |
| Bearing yeild strength                     | Fby         | 386 MPa   |
| Bearing ultimate strength                  | Fbu         | 552 MPa   |
| Yield stress (min{Fcy:Fty})                | Fy          | 241 MPa   |
| Elastic modulus                            | E           | 70000 MPa |
| Shear modulus                              | G           | 26250 MPa |
| Value of coefficients                      | kt          | 1.00      |
|                                            | kc          | 1.00      |
| Capacity factor (general yield)            | $\phi_y$    | 0.95      |
| Capacity factor (ultimate)                 | $\phi_u$    | 0.85      |
| Capacity factor (bending)                  | $\phi_b$    | 0.85      |
| Capacity factor (elastic shear buckling)   | $\phi_v$    | 0.8       |
| Capacity factor (inelastic shear buckling) | $\phi_{vp}$ | 0.9       |

### 3.3 Buckling Constants

| Type of member and stresses                          | Intercept, MPa | Slope, MPa | Intersection |
|------------------------------------------------------|----------------|------------|--------------|
| Compression in columns and beam flanges              | BC= 242.87     | Dc= 1.43   | Cc= 69.61    |
| Compression in flat plates                           | Bp= 310.11     | Dp= 2.06   | Cp= 61.60    |
| Compressive bending stress in solid rectangular bars | Bbr= 459.89    | Dbr= 4.57  | Cbr= 67.16   |
| Compressive bending stress in round tubes            | Btb= 250.32    | Dtb= 14.18 | Ctb= 183.52  |
| Shear stress in flat plates                          | Bs= 178.29     | Ds= 0.90   | Cs= 81.24    |



## Civil & Structural Engineering Design Services Pty. Ltd.

### 3.4 Section Properties

| MEMBER(S)           | Section | b  | d  | t  | yc | Ag              | Zx              | Zy              | Sx              | Sy              | Ix              | Iy              | J               | rx   | ry   |
|---------------------|---------|----|----|----|----|-----------------|-----------------|-----------------|-----------------|-----------------|-----------------|-----------------|-----------------|------|------|
|                     |         | mm | mm | mm | mm | mm <sup>2</sup> | mm <sup>3</sup> | mm <sup>3</sup> | mm <sup>3</sup> | mm <sup>3</sup> | mm <sup>4</sup> | mm <sup>4</sup> | mm <sup>4</sup> | mm   | mm   |
| Rafter              | 82x48x3 | 48 | 82 | 3  | 41 | 744             | 1.63E+04        | 1.19E+04        | 2.00E+04        | 1.37E+04        | 6.69E+05        | 2.86E+05        | 6.12E+05        | 30.0 | 19.6 |
| Upright Support     | 82x48x3 | 48 | 82 | 3  | 41 | 744             | 1.63E+04        | 1.19E+04        | 2.00E+04        | 1.37E+04        | 6.69E+05        | 2.86E+05        | 6.12E+05        | 30.0 | 19.6 |
| Gable Pole          | 82x48x3 | 48 | 82 | 3  | 41 | 744             | 1.63E+04        | 1.19E+04        | 2.00E+04        | 1.37E+04        | 6.69E+05        | 2.86E+05        | 6.12E+05        | 30.0 | 19.6 |
| Ridge & Eave Purlin | 40x40x2 | 40 | 40 | 2  | 20 | 304             | 3.67E+03        | 3.67E+03        | 4.34E+03        | 4.34E+03        | 7.34E+04        | 7.34E+04        | 1.10E+05        | 15.5 | 15.5 |
| Gable Beam          | 40x40x2 | 40 | 40 | 2  | 20 | 304             | 3.67E+03        | 3.67E+03        | 4.34E+03        | 4.34E+03        | 7.34E+04        | 7.34E+04        | 1.10E+05        | 15.5 | 15.5 |
| Intermediate Purlin | 40x40x2 | 40 | 40 | 2  | 20 | 304             | 3.67E+03        | 3.67E+03        | 4.34E+03        | 4.34E+03        | 7.34E+04        | 7.34E+04        | 1.10E+05        | 15.5 | 15.5 |
| Brace               | 40x40x2 | 40 | 40 | 2  | 20 | 304             | 3.67E+03        | 3.67E+03        | 4.34E+03        | 4.34E+03        | 7.34E+04        | 7.34E+04        | 1.10E+05        | 15.5 | 15.5 |

## 4 Design Loads

### 4.1 Ultimate

|                 |   | Distributed load (kPa) | Design load factor (-) | Factored imposed load (kPa)      |
|-----------------|---|------------------------|------------------------|----------------------------------|
| Live            | Q | -                      | 1.5                    | -                                |
| Self weight     | G | self weight            | 1.35, 1.2, 0.9         | 1.2 self weight, 0.9 self weight |
| 3s 80km/hr gust | W | 0.245 C <sub>fig</sub> | 1.0                    | 0.245 C <sub>fig</sub>           |

### 4.2 Load Combinations

#### 4.2.1 Serviceability

Gravity =  $1.0 \times G$

Wind =  $1.0 \times G + 1.0 \times W$

#### 4.2.2 Ultimate

Downward =  $1.35 \times G$   
 =  $1.2 \times G + W_u$   
 =  $1.2 \times G + W_u + W_{IS}$

Upward =  $0.9 \times G + W_u$   
 =  $0.9 \times G + W_u + W_{IP}$



## 5 Wind Analysis

Wind towards surface (+ve), away from surface (-ve)

### 5.1 Parameters & Coefficients ( $C_{fig}$ )

| Name                             | Symbol           | Value       | Unit              | Notes                                                | Ref.                             |
|----------------------------------|------------------|-------------|-------------------|------------------------------------------------------|----------------------------------|
| <b>Input</b>                     |                  |             |                   |                                                      |                                  |
| Importance level                 |                  | 2           |                   |                                                      | Table 3.1 - Table 3.2 (AS1170.0) |
| Annual probability of exceedance |                  | < 6 months  |                   |                                                      | Table 3.3                        |
| Regional gust wind speed         |                  | 80          | Km/hr             |                                                      | Table 3.1 (AS1170.2)             |
| Regional gust wind speed         | $V_R$            | 22.22       | m/s               |                                                      |                                  |
| Wind Direction Multipliers       | $M_d$            | 1           |                   |                                                      | Table 3.2 (AS1170.2)             |
| Terrain Category Multiplier      | $M_{z,Cat}$      | 0.91        |                   |                                                      | Table 4.1 (AS1170.2)             |
| Shield Multiplier                | $M_S$            | 1           |                   |                                                      | 4.3 (AS1170.2)                   |
| Topographic Multiplier           | $M_t$            | 1           |                   |                                                      | 4.4 (AS1170.2)                   |
| Site Wind Speed                  | $V_{Site,\beta}$ | 20.22       | m/s               | $V_{Site,\beta} = V_R * M_d * M_{z,Cat} * M_S * M_t$ |                                  |
| Pitch                            | $\alpha$         | 20          | Deg               |                                                      |                                  |
| Pitch                            | $\alpha$         | 0.349       | rad               |                                                      |                                  |
| Width                            | B                | 9           | m                 |                                                      |                                  |
| Width Span                       | $S_w$            | 3           | m                 |                                                      |                                  |
| Length                           | D                | 9           | m                 |                                                      |                                  |
| Height                           | Z                | 3.4         | m                 |                                                      |                                  |
| Bay Span                         |                  | 3           | m                 |                                                      |                                  |
| Purlin Spacing                   |                  | 1.6         | m                 |                                                      |                                  |
| Number of Intermediate Purlin    |                  | 2           |                   |                                                      |                                  |
|                                  | h/d              | 0.378       |                   |                                                      |                                  |
|                                  | h/b              | 0.377777778 |                   |                                                      |                                  |
| <b>Wind Pressure</b>             |                  |             |                   |                                                      |                                  |
| $\rho_{air}$                     | $\rho$           | 1.2         | Kg/m <sup>3</sup> |                                                      |                                  |





## Civil & Structural Engineering Design Services Pty. Ltd.

|                                                                |                                                 |       |                   |                                                                  |                        |
|----------------------------------------------------------------|-------------------------------------------------|-------|-------------------|------------------------------------------------------------------|------------------------|
| dynamic response factor                                        | $C_{dyn}$                                       | 1     |                   |                                                                  |                        |
| Wind Pressure                                                  | $\rho / C_{fig}$                                | 0.245 | Kg/m <sup>2</sup> | $\rho = 0.5 \rho_{air} * (V_{des, \beta})^2 * C_{fig} * C_{dyn}$ | 2.4 (AS1170.2)         |
| <b>WIND DIRECTION 1 (Perpendicular to Length)</b>              |                                                 |       |                   |                                                                  |                        |
| <b>Internal Pressure</b>                                       |                                                 |       |                   |                                                                  |                        |
| Opening Assumption                                             | <div>With Dominant Opening (Cpi = nCpe) ▼</div> |       |                   |                                                                  |                        |
| Internal Pressure Coefficient<br>(Without Dominant) <b>MIN</b> |                                                 | -0.1  |                   |                                                                  | Table 5.1 A (AS1170.2) |
| Internal Pressure Coefficient<br>(Without Dominant) <b>MAX</b> |                                                 | 0.2   |                   |                                                                  |                        |
| Internal Pressure Coefficient<br>(With Dominant) <b>MIN</b>    |                                                 | -0.1  |                   |                                                                  | Table 5.1 B (AS1170.2) |
| Internal Pressure Coefficient<br>(With Dominant) <b>MAX</b>    |                                                 | 0.2   |                   |                                                                  |                        |
| N                                                              |                                                 | 0.7   |                   |                                                                  |                        |
| Combination Factor                                             | $K_{C,i}$                                       | 1     |                   |                                                                  |                        |
| Internal Pressure Coefficient<br><b>MIN</b>                    | $C_{p,i}$                                       | 0.70  |                   |                                                                  |                        |
| Internal Pressure Coefficient<br><b>MAX</b>                    | $C_{p,i}$                                       | 0.70  |                   |                                                                  |                        |
| <b>External Pressure</b>                                       |                                                 |       |                   |                                                                  |                        |
| <b>1. Windward Wall</b>                                        |                                                 |       |                   |                                                                  |                        |
| External Pressure Coefficient                                  | $C_{P,e}$                                       | 0.7   |                   |                                                                  | Table 5.2 A            |
| Area Reduction Factor                                          | $K_a$                                           | 0.8   |                   |                                                                  | Table 5.4              |
| combination factor applied to<br>internal pressures            | $K_{C,e}$                                       | 1     |                   |                                                                  |                        |
| local pressure factor                                          | $K_l$                                           | 1     |                   |                                                                  |                        |
| porous cladding reduction<br>factor                            | $K_p$                                           | 1     |                   |                                                                  |                        |
| aerodynamic shape factor                                       | $C_{fig,e}$                                     | 0.56  |                   |                                                                  |                        |
| Wind Wall Pressure                                             | P                                               | 0.14  | kPa               |                                                                  |                        |
| Edge Column Force                                              | F                                               | 0.21  | kN/m              |                                                                  |                        |
| Intermediate Column Force                                      | F                                               | 0.41  | kN/m              |                                                                  |                        |
| <b>2. Leeward Wall</b>                                         |                                                 |       |                   |                                                                  |                        |



## Civil & Structural Engineering Design Services Pty. Ltd.

|                                                  |             |       |      |                     |             |
|--------------------------------------------------|-------------|-------|------|---------------------|-------------|
| External Pressure Coefficient                    | $C_{P,e}$   | -0.4  |      |                     | Table 5.2 B |
| Area Reduction Factor                            | $K_a$       | 0.8   |      |                     | Table 5.4   |
| combination factor applied to internal pressures | $K_{C,e}$   | 1     |      |                     |             |
| local pressure factor                            | $K_l$       | 1     |      |                     |             |
| porous cladding reduction factor                 | $K_p$       | 1     |      |                     |             |
| aerodynamic shape factor                         | $C_{fig,e}$ | -0.32 |      |                     |             |
| Lee Wall Pressure                                | P           | -0.08 | kPa  |                     |             |
| Edge Column Force                                | F           | -0.12 | kN/m |                     |             |
| Intermediate Column Force                        | F           | -0.24 | kN/m |                     |             |
| <b>3. Side Wall</b>                              |             |       |      |                     |             |
| Area Reduction Factor                            | $K_a$       | 0.8   |      |                     | Table 5.2 C |
| combination factor applied to internal pressures | $K_{C,e}$   | 1     |      |                     | Table 5.4   |
| local pressure factor                            | $K_l$       | 1     |      |                     |             |
| porous cladding reduction factor                 | $K_p$       | 1     |      |                     |             |
| External Pressure Coefficient                    | $C_{P,e}$   | -0.65 |      | 0 to 1h             |             |
| External Pressure Coefficient                    | $C_{P,e}$   | -0.5  |      | 1h to 2h            |             |
| External Pressure Coefficient                    | $C_{P,e}$   | -0.3  |      | 2h to 3h            |             |
| External Pressure Coefficient                    | $C_{P,e}$   | -0.2  |      | >3h                 |             |
| aerodynamic shape factor                         | $C_{fig,e}$ | -0.52 |      | 0 to 1h             |             |
| aerodynamic shape factor                         | $C_{fig,e}$ | -0.4  |      | 1h to 2h            |             |
| aerodynamic shape factor                         | $C_{fig,e}$ | -0.24 |      | 2h to 3h            |             |
| aerodynamic shape factor                         | $C_{fig,e}$ | -0.16 |      | >3h                 |             |
| Side Wall Pressure                               | P           | -0.13 | kPa  | 0 to 1h             |             |
| Side Wall Pressure                               | P           | -0.10 | kPa  | 1h to 2h            |             |
| Side Wall Pressure                               | P           | -0.06 | kPa  | 2h to 3h            |             |
| Side Wall Pressure                               | P           | -0.04 | kPa  | >3h                 |             |
| <b>4. Roof Up Wind Slop</b>                      |             |       |      | $\alpha > 10^\circ$ |             |
| Area Reduction Factor                            | $K_a$       | 0.8   |      |                     | Table 5.3 B |
| combination factor applied to internal pressures | $K_{C,e}$   | 1     |      |                     |             |



## Civil & Structural Engineering Design Services Pty. Ltd.

|                                                  |             |       |      |
|--------------------------------------------------|-------------|-------|------|
| local pressure factor                            | $K_l$       | 1     |      |
| porous cladding reduction factor                 | $K_p$       | 1     |      |
| External Pressure Coefficient <b>MIN</b>         | $C_{P,e}$   | -0.35 |      |
| External Pressure Coefficient <b>MAX</b>         | $C_{P,e}$   | 0.1   |      |
| aerodynamic shape factor <b>MIN</b>              | $C_{fig,e}$ | -0.28 |      |
| aerodynamic shape factor <b>MAX</b>              | $C_{fig,e}$ | 0.08  |      |
| Pressure <b>MIN</b>                              | P           | -0.07 | kPa  |
| Pressure <b>MAX</b>                              | P           | 0.02  | kPa  |
| Edge Rafter Force <b>MIN</b>                     | F           | -0.10 | kN/m |
| Edge Rafter Force <b>Max</b>                     | F           | 0.03  | kN/m |
| Intermediate Rafter Force <b>MIN</b>             | F           | -0.21 | kN/m |
| Intermediate Rafter Force <b>MAX</b>             | F           | 0.06  | kN/m |
| <b>5. Roof Down Wind Slop</b>                    |             |       |      |
| Area Reduction Factor                            | $K_a$       | 0.8   |      |
| combination factor applied to internal pressures | $K_{C,e}$   | 1     |      |
| local pressure factor                            | $K_l$       | 1     |      |
| porous cladding reduction factor                 | $K_p$       | 1     |      |
| External Pressure Coefficient                    | $C_{P,e}$   | -0.6  |      |
| aerodynamic shape factor                         | $C_{fig,e}$ | -0.48 |      |
| Pressure <b>MIN</b>                              | P           | -0.12 | kPa  |
| Pressure <b>MAX</b>                              | P           | -0.12 | kPa  |
| Edge Rafter Force <b>MIN</b>                     | F           | -0.18 | kN/m |
| Edge Rafter Force <b>MAX</b>                     | F           | -0.18 | kN/m |
| Intermediate Rafter Force <b>MIN</b>             | F           | -0.35 | kN/m |
| Intermediate Rafter Force <b>MAX</b>             | F           | -0.35 | kN/m |

### WIND DIRECTION 2 (Parallel to Length)

#### Internal Pressure



## Civil & Structural Engineering Design Services Pty. Ltd.

Opening Assumption

With Dominant Opening ( $C_{pi} = nC_{pe}$ )



Internal Pressure Coefficient  
(Without Dominant) **MIN**

-0.1

Table 5.1 A (AS1170.2)

Internal Pressure Coefficient  
(Without Dominant) **MAX**

0.2

Internal Pressure Coefficient  
(With Dominant) **MIN**

-0.1

Table 5.1 B (AS1170.2)

Internal Pressure Coefficient  
(With Dominant) **MAX**

0.2

N

0.7

$C_{pi} = N * C_{pe}$

Combination Factor

$K_{C,i}$

1

Internal Pressure Coefficient  
**MIN**

$C_{p,i}$

0.70

Internal Pressure Coefficient  
**MAX**

$C_{p,i}$

0.70

### External Pressure

#### 1. Windward Wall

External Pressure  
Coefficient

$C_{p,e}$

0.7

Table 5.2 A

Area Reduction Factor

$K_a$

0.8

Table 5.4

combination factor applied to  
internal pressures

$K_{C,e}$

1

local pressure factor

$K_l$

1

porous cladding reduction  
factor

$K_p$

1

aerodynamic shape factor

$C_{fig,e}$

0.56

Wind Wall Pressure

P

0.14

kPa

Edge Column Force

F

0.21

kN/m

Intermediate Column Force

F

0.41

kN/m

#### 2. Leeward Wall

External Pressure  
Coefficient

$C_{p,e}$

-0.4

Table 5.2 B

Area Reduction Factor

$K_a$

0.8

Table 5.4

combination factor applied to  
internal pressures

$K_{C,e}$

1

local pressure factor

$K_l$

1

porous cladding reduction  
factor

$K_p$

1



## Civil & Structural Engineering Design Services Pty. Ltd.

|                                                  |             |       |      |                     |             |
|--------------------------------------------------|-------------|-------|------|---------------------|-------------|
| aerodynamic shape factor                         | $C_{fig,e}$ | -0.32 |      |                     |             |
| Lee Wall Pressure                                | P           | -0.08 | kPa  |                     |             |
| Edge Column Force                                | F           | -0.12 | kN/m |                     |             |
| Intermediate Column Force                        | F           | -0.24 | kN/m |                     |             |
| <b>3. Side Wall</b>                              |             |       |      |                     |             |
| Area Reduction Factor                            | $K_a$       | 0.8   |      |                     | Table 5.2 C |
| combination factor applied to internal pressures | $K_{C,e}$   | 1     |      |                     | Table 5.4   |
| local pressure factor                            | $K_l$       | 1     |      |                     |             |
| porous cladding reduction factor                 | $K_p$       | 1     |      |                     |             |
| External Pressure Coefficient                    | $C_{P,e}$   | -0.65 |      | 0 to 1h             |             |
| External Pressure Coefficient                    | $C_{P,e}$   | -0.5  |      | 1h to 2h            |             |
| External Pressure Coefficient                    | $C_{P,e}$   | -0.3  |      | 2h to 3h            |             |
| External Pressure Coefficient                    | $C_{P,e}$   | -0.2  |      | >3h                 |             |
| aerodynamic shape factor                         | $C_{fig,e}$ | -0.52 |      | 0 to 1h             |             |
| aerodynamic shape factor                         | $C_{fig,e}$ | -0.4  |      | 1h to 2h            |             |
| Side Wall Pressure                               | P           | -0.13 | kPa  | 0 to 1h             |             |
| Side Wall Pressure                               | P           | -0.10 | kPa  | 1h to 2h            |             |
| Side Wall Pressure                               | P           | -0.06 | kPa  | 2h to 3h            |             |
| Side Wall Pressure                               | P           | -0.04 | kPa  | >3h                 |             |
| <b>4. Roof</b>                                   |             |       |      | $\alpha < 10^\circ$ |             |
| Area Reduction Factor                            | $K_a$       | 0.8   |      |                     | Table 5.3 A |
| combination factor applied to internal pressures | $K_{C,e}$   | 1     |      |                     |             |
| local pressure factor                            | $K_l$       | 1     |      |                     |             |
| porous cladding reduction factor                 | $K_p$       | 1     |      |                     |             |
| External Pressure Coefficient MIN                | $C_{P,e}$   | -0.9  |      | 0 to 0.5h           |             |
| External Pressure Coefficient MIN                | $C_{P,e}$   | -0.9  |      | 0.5 to 1h           |             |



## Civil & Structural Engineering Design Services Pty. Ltd.

|                                          |             |       |     |           |
|------------------------------------------|-------------|-------|-----|-----------|
| External Pressure Coefficient <b>MIN</b> | $C_{P,e}$   | -0.50 |     | 1h to 2h  |
| External Pressure Coefficient <b>MIN</b> | $C_{P,e}$   | -0.30 |     | 2h to 3h  |
| External Pressure Coefficient <b>MIN</b> | $C_{P,e}$   | -0.2  |     | >3h       |
| External Pressure Coefficient <b>MAX</b> | $C_{P,e}$   | -0.4  |     | 0 to 0.5h |
| External Pressure Coefficient <b>MAX</b> | $C_{P,e}$   | -0.4  |     | 0.5 to 1h |
| External Pressure Coefficient <b>MAX</b> | $C_{P,e}$   | 0     |     | 1h to 2h  |
| External Pressure Coefficient <b>MAX</b> | $C_{P,e}$   | 0.1   |     | 2h to 3h  |
| External Pressure Coefficient <b>MAX</b> | $C_{P,e}$   | 0.2   |     | >3h       |
| aerodynamic shape factor <b>MIN</b>      | $C_{fig,e}$ | -0.72 |     | 0 to 0.5h |
| aerodynamic shape factor <b>MIN</b>      | $C_{fig,e}$ | -0.72 |     | 0.5 to 1h |
| aerodynamic shape factor <b>MIN</b>      | $C_{fig,e}$ | -0.4  |     | 1h to 2h  |
| aerodynamic shape factor <b>MIN</b>      | $C_{fig,e}$ | -0.24 |     | 2h to 3h  |
| aerodynamic shape factor <b>MIN</b>      | $C_{fig,e}$ | -0.16 |     | >3h       |
| aerodynamic shape factor <b>MAX</b>      | $C_{fig,e}$ | -0.32 |     | 0 to 0.5h |
| aerodynamic shape factor <b>MAX</b>      | $C_{fig,e}$ | -0.32 |     | 0.5 to 1h |
| aerodynamic shape factor <b>MAX</b>      | $C_{fig,e}$ | 0     |     | 1h to 2h  |
| aerodynamic shape factor <b>MAX</b>      | $C_{fig,e}$ | 0.08  |     | 2h to 3h  |
| aerodynamic shape factor <b>MAX</b>      | $C_{fig,e}$ | 0.16  |     | >3h       |
| Pressure <b>MIN</b>                      | <b>P</b>    | -0.18 | kPa | 0 to 0.5h |
| Pressure <b>MIN</b>                      | <b>P</b>    | -0.18 | kPa | 0.5 to 1h |
| Pressure <b>MIN</b>                      | <b>P</b>    | -0.10 | kPa | 1h to 2h  |
| Pressure <b>MIN</b>                      | <b>P</b>    | -0.06 | kPa | 2h to 3h  |
| Pressure <b>MIN</b>                      | <b>P</b>    | -0.04 | kPa | >3h       |
| Pressure <b>MAX</b>                      | <b>P</b>    | -0.08 | kPa | 0 to 0.5h |
| Pressure <b>MAX</b>                      | <b>P</b>    | -0.08 | kPa | 0.5 to 1h |
| Pressure <b>MAX</b>                      | <b>P</b>    | 0.00  | kPa | 1h to 2h  |
| Pressure <b>MAX</b>                      | <b>P</b>    | 0.02  | kPa | 2h to 3h  |
| Pressure <b>MAX</b>                      | <b>P</b>    | 0.04  | kPa | >3h       |



## Civil & Structural Engineering Design Services Pty. Ltd.

|                                      |   |       |      |           |
|--------------------------------------|---|-------|------|-----------|
| Edge Purlin Force <b>MIN</b>         | F | -0.14 | kN/m | 0 to 0.5h |
| Edge Purlin Force <b>MIN</b>         | F | -0.14 | kN/m | 0.5 to 1h |
| Edge Purlin Force <b>MIN</b>         | F | -0.08 | kN/m | 1h to 2h  |
| Edge Purlin Force <b>MIN</b>         | F | -0.05 | kN/m | 2h to 3h  |
| Edge Purlin Force <b>MIN</b>         | F | -0.03 | kN/m | >3h       |
| <b>Edge Purlin Force MAX</b>         | F | -0.06 | kN/m | 0 to 0.5h |
| <b>Edge Purlin Force MAX</b>         | F | -0.06 | kN/m | 0.5 to 1h |
| <b>Edge Purlin Force MAX</b>         | F | 0.00  | kN/m | 1h to 2h  |
| <b>Edge Purlin Force MAX</b>         | F | 0.02  | kN/m | 2h to 3h  |
| <b>Edge Purlin Force MAX</b>         | F | 0.03  | kN/m | >3h       |
| Intermediate Purlin Force <b>MIN</b> | F | -0.28 | kN/m | 0 to 0.5h |
| Intermediate Purlin Force <b>MIN</b> | F | -0.28 | kN/m | 0.5 to 1h |
| Intermediate Purlin Force <b>MIN</b> | F | -0.16 | kN/m | 1h to 2h  |
| Intermediate Purlin Force <b>MIN</b> | F | -0.09 | kN/m | 2h to 3h  |
| Intermediate Purlin Force <b>MIN</b> | F | -0.06 | kN/m | >3h       |
| Intermediate Purlin Force <b>MAX</b> | F | -0.13 | kN/m | 0 to 0.5h |
| Intermediate Purlin Force <b>MAX</b> | F | -0.13 | kN/m | 0.5 to 1h |
| Intermediate Purlin Force <b>MAX</b> | F | 0.00  | kN/m | 1h to 2h  |
| Intermediate Purlin Force <b>MAX</b> | F | 0.03  | kN/m | 2h to 3h  |
| Intermediate Purlin Force <b>MAX</b> | F | 0.06  | kN/m | >3h       |



## Civil & Structural Engineering Design Services Pty. Ltd.


### 5.2 Pressure (P)

$$C_{fig,i} = C_{p,i} k_{c,i}$$


$$C_{fig,e} = C_{p,e} k_a k_{c,e} k_l k_p$$

#### 5.2.1 Pressure summary

| WIND EXTERNAL PRESSURE       |                |                   | Direction1        |                   | Direction2 |       |                   |           |           |
|------------------------------|----------------|-------------------|-------------------|-------------------|------------|-------|-------------------|-----------|-----------|
| Windward (kPa)               |                |                   | 0.14              |                   | 0.14       |       |                   |           |           |
| Leeward (kPa)                |                |                   | -0.08             |                   | -0.08      |       |                   |           |           |
| Sidewall (m)                 | Length         | (m)               | (m)               | (Kpa)             | (Kpa)      |       |                   |           |           |
|                              | 0 - 1h         | 0                 | 3.4               | -0.13             | -0.13      |       |                   |           |           |
|                              | 1h - 2h        | 3.4               | 6.8               | -0.10             | -0.10      |       |                   |           |           |
|                              | 2h - 3h        | 6.8               | 10.2              | -0.06             | -0.06      |       |                   |           |           |
|                              | >3h            | 10.2              | -                 | -0.04             | -0.04      |       |                   |           |           |
| Roof                         |                |                   | Min (Kpa)         | Max (Kpa)         | Length     | (m)   | (m)               | Min (Kpa) | Max (Kpa) |
|                              | Upwind Slope   |                   | -0.07             | 0.02              | 0-0.5h     | 0.00  | 1.70              | -0.18     | -0.08     |
|                              | Downwind Slope |                   | -0.12             | -0.12             | 0.5h-1h    | 1.70  | 3.40              | -0.18     | -0.08     |
|                              |                |                   |                   |                   | 1h-2h      | 3.40  | 6.80              | -0.10     | 0.00      |
|                              |                |                   |                   |                   | 2h-3h      | 6.80  | 10.20             | -0.06     | 0.02      |
|                              |                |                   |                   |                   | >3h        | 10.20 | -                 | -0.04     | 0.04      |
|                              |                |                   |                   |                   |            |       |                   |           |           |
| Wind Internal Pressure (kPa) |                | Min (kPa)         | Max (kPa)         | Min (kPa)         |            |       | Max (kPa)         |           |           |
|                              |                | Proportion of Cpe | Proportion of Cpe | Proportion of Cpe |            |       | Proportion of Cpe |           |           |

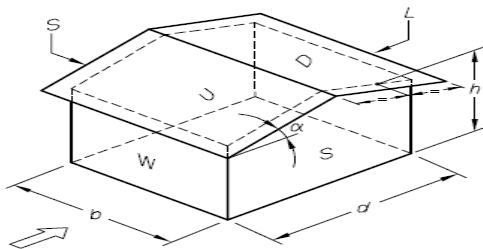

Direction 1

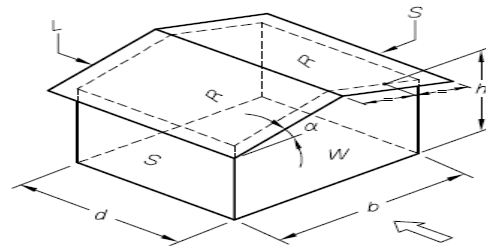

Direction 2

AS1170.2







## Civil & Structural Engineering Design Services Pty. Ltd.

### 5.3 Wind Load Diagrams

#### 5.3.1 Wind 1(case 1)

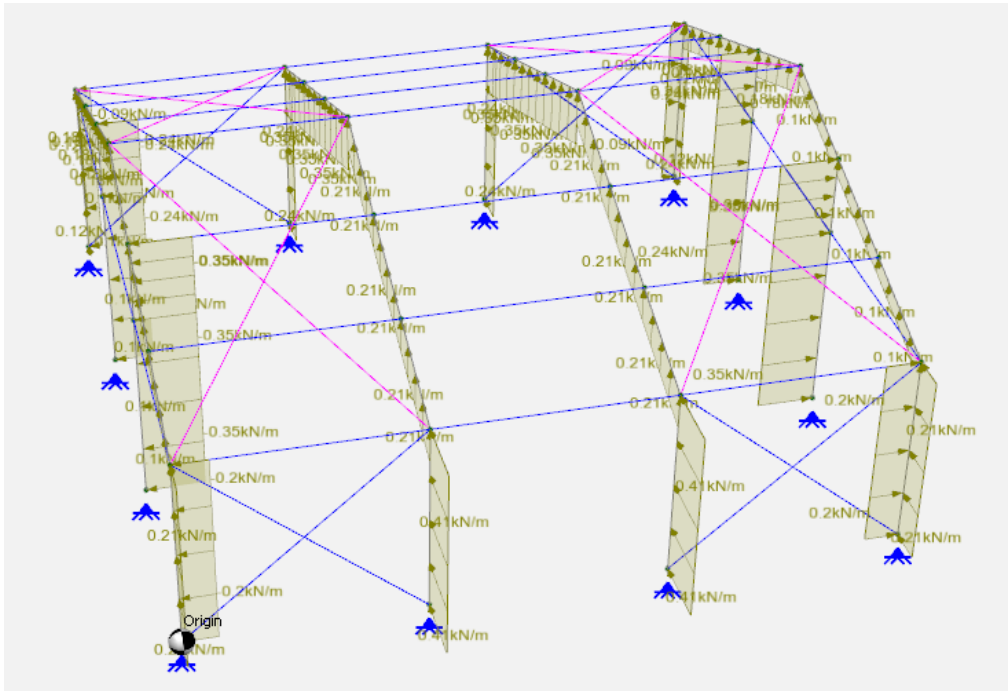


#### 5.3.2 Wind 1(case 2)

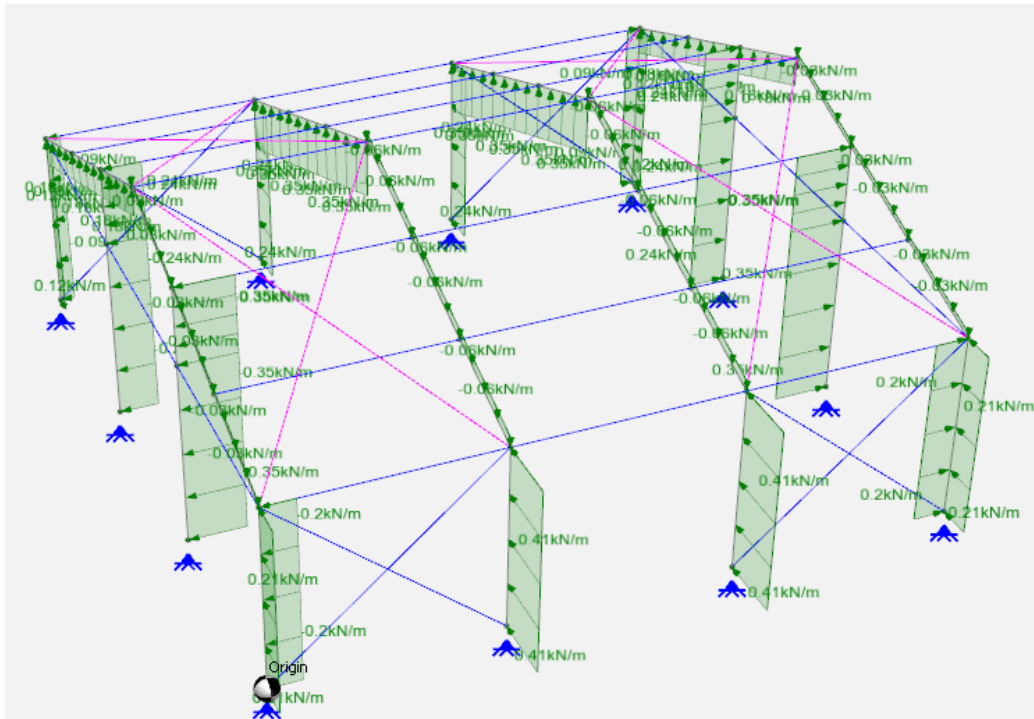




## Civil & Structural Engineering Design Services Pty. Ltd.

### 5.3.3 Wind 2(Case1)

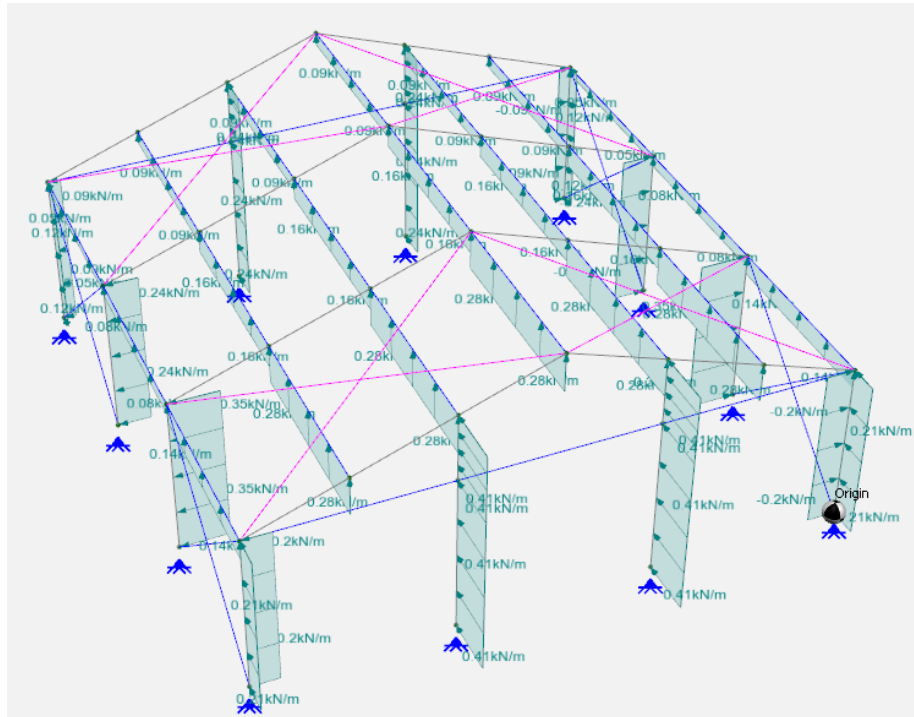

### 5.3.4 Wind 2(case 2)

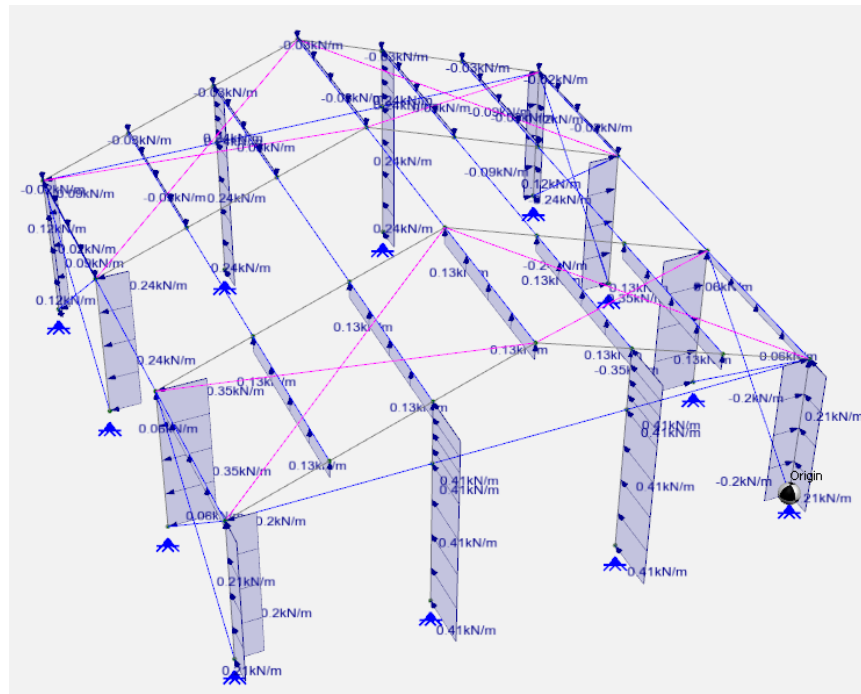


After 3D model analysis, each member is checked based on adverse load combination.

In this regard the maximum bending moment, shear and axial force due to adverse load combinations for each member are presented as below:




## Civil & Structural Engineering Design Services Pty. Ltd.

### 5.3.5 Max Bending Moment due to critical load combination in major axis

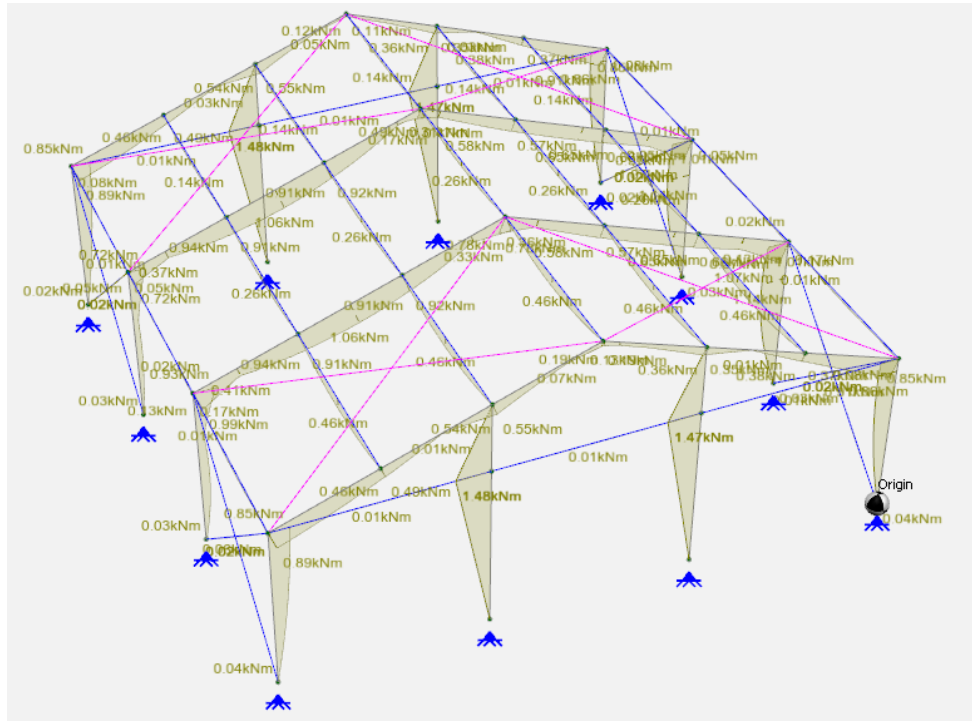


### 5.3.6 Max Bending Moment in minor axis due to critical load combination

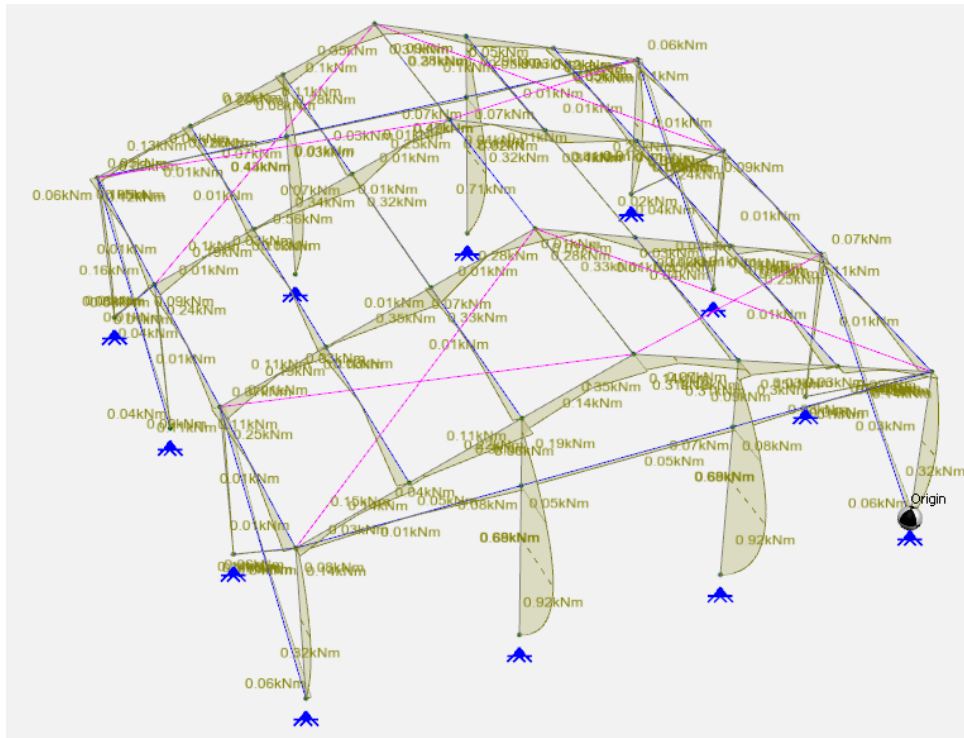




## Civil & Structural Engineering Design Services Pty. Ltd.

### 5.3.7 Max Shear in due to critical load combination

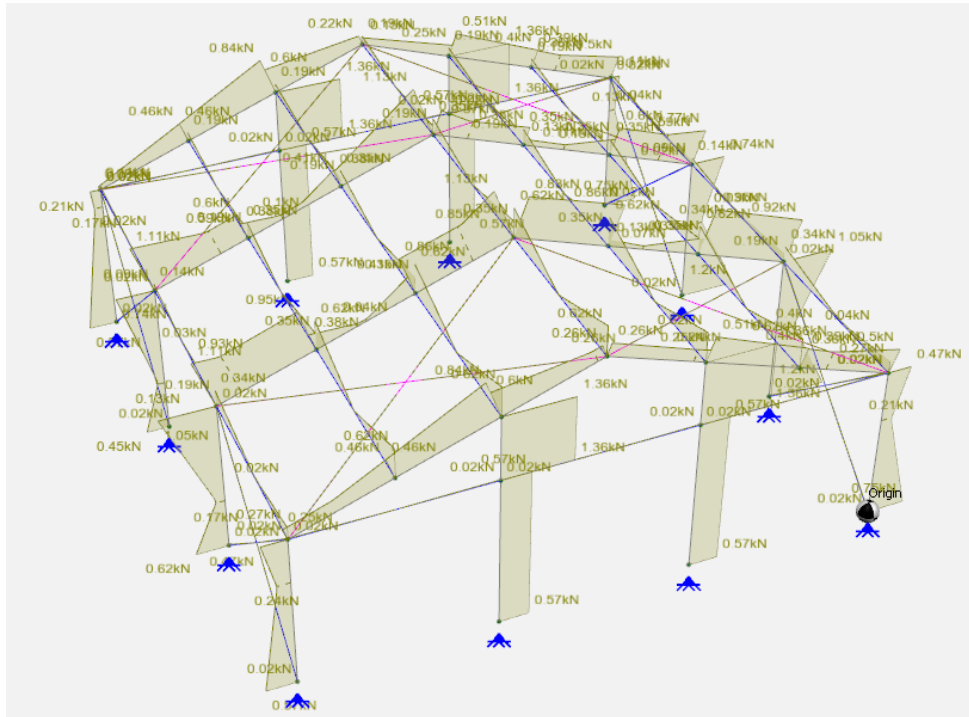


### 5.3.8 Max Axial force in upright support and roof beam due to critical load combination

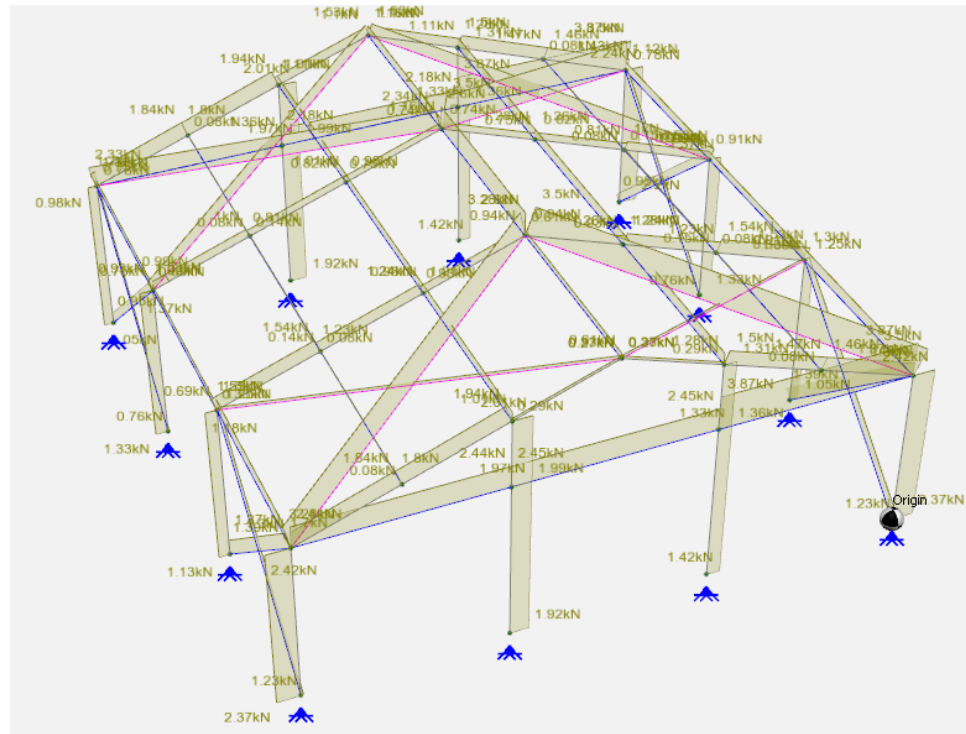



## Civil & Structural Engineering Design Services Pty. Ltd.

### 5.3.9 Max reactions

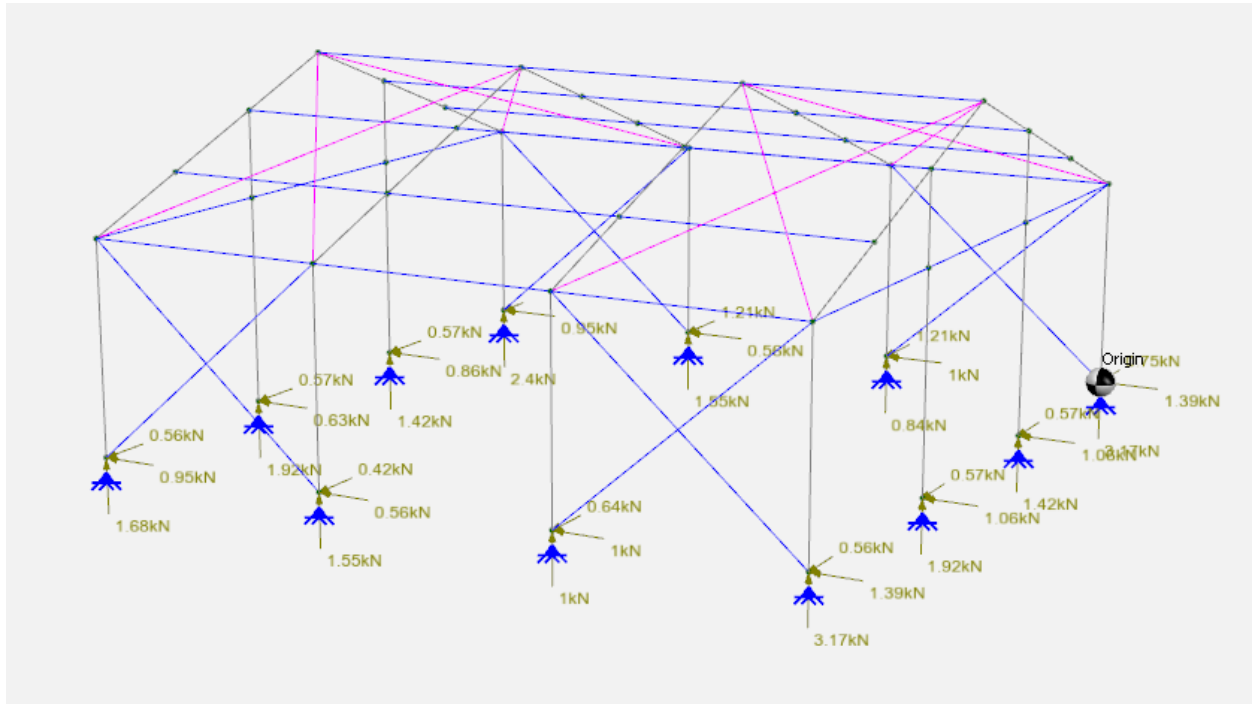

Max Reaction  $N^* = 3.2 \text{ kN}$

### 5.3.10 Summary Table:

| MEMBER(S)           | Section | b  | d  | t  | P    | Mx   | My   |
|---------------------|---------|----|----|----|------|------|------|
|                     |         | mm | mm | mm | kN   | kN.m | kN.m |
| Rafter              | 82x48x3 | 48 | 82 | 3  | 2    | 1.07 | 0.35 |
| Upright Support     | 82x48x3 | 48 | 82 | 3  | 2.42 | 1.14 | 0.32 |
| Gable Pole          | 82x48x3 | 48 | 82 | 3  | 1.9  | 1.4  | 0.9  |
| Ridge & Eave Purlin | 40x40x2 | 40 | 40 | 2  | 2.6  | 0.26 | 0.01 |
| Gable Beam          | 40x40x2 | 40 | 40 | 2  | 3.87 | 0.08 | 0.08 |
| Intermediate Purlin | 40x40x2 | 40 | 40 | 2  | 1.28 | 0.46 | 0.07 |
| Brace               | 40x40x2 | 40 | 40 | 2  | 1.3  | 0.08 | 0.08 |



## 6 Checking Members Based on AS1664.1 ALUMINIUM LSD

### 6.1 Upright Supports

| NAME                                                      | SYMBOL                   | VALUE       | UNIT            | NOTES       | REF         |
|-----------------------------------------------------------|--------------------------|-------------|-----------------|-------------|-------------|
| <b>82x48x3</b>                                            | <b>(Upright Support)</b> |             |                 |             |             |
| Alloy and temper                                          | 6061-T6                  |             |                 |             | AS1664.1    |
| Tension                                                   | $F_{tu}$                 | = 262       | MPa             | Ultimate    | T3.3(A)     |
|                                                           | $F_{ty}$                 | = 241       | MPa             | Yield       |             |
| Compression                                               | $F_{cy}$                 | = 241       | MPa             |             |             |
| Shear                                                     | $F_{su}$                 | = 165       | MPa             | Ultimate    |             |
|                                                           | $F_{sy}$                 | = 138       | MPa             | Yield       |             |
| Bearing                                                   | $F_{bu}$                 | = 551       | MPa             | Ultimate    |             |
|                                                           | $F_{by}$                 | = 386       | MPa             | Yield       |             |
| Modulus of elasticity                                     | E                        | = 70000     | MPa             | Compressive |             |
|                                                           | $k_t$                    | = 1.0       |                 |             | T3.4(B)     |
|                                                           | $k_c$                    | = 1.0       |                 |             |             |
| <b>FEM ANALYSIS RESULTS</b>                               |                          |             |                 |             |             |
| Axial force                                               | P                        | = 2.42      | kN              | compression |             |
| In plane moment                                           | $M_x$                    | = 1.14      | kNm             |             |             |
| Out of plane moment                                       | $M_y$                    | = 0.32      | kNm             |             |             |
| <b>DESIGN STRESSES</b>                                    |                          |             |                 |             |             |
| Gross cross section area                                  | $A_g$                    | = 744       | mm <sup>2</sup> |             |             |
| In-plane elastic section modulus                          | $Z_x$                    | = 16318.439 | mm <sup>3</sup> |             |             |
| Out-of-plane elastic section mod.                         | $Z_y$                    | = 11937     | mm <sup>3</sup> |             |             |
| Stress from axial force                                   | $f_a$                    | = $P/A_g$   |                 |             |             |
|                                                           |                          | = 3.25      | MPa             | compression |             |
| Stress from in-plane bending                              | $f_{bx}$                 | = $M_x/Z_x$ |                 |             |             |
|                                                           |                          | = 69.86     | MPa             | compression |             |
| Stress from out-of-plane bending                          | $f_{by}$                 | = $M_y/Z_y$ |                 |             |             |
|                                                           |                          | = 26.81     | MPa             | compression |             |
| <b>COMPRESSION</b>                                        |                          |             |                 |             |             |
| <b>3.4.8 Compression in columns, axial, gross section</b> |                          |             |                 |             |             |
| <b>1. General</b>                                         |                          |             |                 |             |             |
|                                                           |                          |             |                 |             | ... 3.4.8.1 |





## Civil & Structural Engineering Design Services Pty. Ltd.

|                                                                                                        |             |   |        |     |                   |                            |
|--------------------------------------------------------------------------------------------------------|-------------|---|--------|-----|-------------------|----------------------------|
| Unsupported length of member                                                                           | L           | = | 2600   | mm  |                   |                            |
| Effective length factor                                                                                | k           | = | 1      |     |                   |                            |
| Radius of gyration about buckling axis                                                                 | r           | = | 19.62  | mm  |                   |                            |
| Slenderness ratio                                                                                      | kL/r        | = | 132.50 |     |                   |                            |
| Slenderness parameter                                                                                  | $\lambda$   | = | 2.47   |     |                   |                            |
|                                                                                                        | $D_c^*$     | = | 90.3   |     |                   |                            |
|                                                                                                        | $S_1^*$     | = | 0.33   |     |                   |                            |
|                                                                                                        | $S_2^*$     | = | 1.23   |     |                   |                            |
|                                                                                                        | $\phi_{cc}$ | = | 0.926  |     |                   |                            |
| Factored limit state stress                                                                            | $\phi F_L$  | = | 36.46  | MPa |                   |                            |
| 2. Sections not subject to torsional or torsional-flexural buckling                                    |             |   |        |     |                   | ... 3.4.8.2                |
| Largest slenderness ratio for flexural buckling                                                        | kL/r        | = | 132.50 |     |                   |                            |
| <b>3.4.10 Uniform compression in components of columns, gross section - flat plates</b>                |             |   |        |     |                   |                            |
| 1. Uniform compression in components of columns, gross section - flat plates with both edges supported |             |   |        |     |                   | ...<br>3.4.10.1<br>T3.3(D) |
|                                                                                                        | $k_1$       | = | 0.35   |     |                   |                            |
| Max. distance between toes of fillets of supporting elements for plate                                 | $b'$        | = | 42     |     |                   |                            |
|                                                                                                        | t           | = | 3      | mm  |                   |                            |
| Slenderness                                                                                            | b/t         | = | 14     |     |                   |                            |
| Limit 1                                                                                                | $S_1$       | = | 12.34  |     |                   |                            |
| Limit 2                                                                                                | $S_2$       | = | 32.87  |     | $S_1 < b/t < S_2$ |                            |
| Factored limit state stress                                                                            | $\phi F_L$  | = | 224.30 | MPa |                   |                            |
| Most adverse compressive limit state stress                                                            | $F_a$       | = | 36.46  | MPa |                   |                            |
| Most adverse compressive capacity factor                                                               | $f_a/F_a$   | = | 0.09   |     | PASS              |                            |
| <b>BENDING - IN-PLANE</b>                                                                              |             |   |        |     |                   |                            |
| <b>3.4.15 Compression in beams, extreme fibre, gross section rectangular tubes, box sections</b>       |             |   |        |     |                   |                            |
| Unbraced length for bending                                                                            | $L_b$       | = | 2600   | mm  |                   |                            |



## Civil & Structural Engineering Design Services Pty. Ltd.

|                                                                                                                                               |                                  |   |          |                 |               |           |
|-----------------------------------------------------------------------------------------------------------------------------------------------|----------------------------------|---|----------|-----------------|---------------|-----------|
| Second moment of area (weak axis)                                                                                                             | $I_y$                            | = | 2.86E+05 | mm <sup>4</sup> |               |           |
| Torsion modulus                                                                                                                               | J                                | = | 6.12E+05 | mm <sup>3</sup> |               |           |
| Elastic section modulus                                                                                                                       | Z                                | = | 11937    | mm <sup>3</sup> |               |           |
| Slenderness                                                                                                                                   | S                                | = | 148.30   |                 |               |           |
| Limit 1                                                                                                                                       | S <sub>1</sub>                   | = | 0.39     |                 |               |           |
| Limit 2                                                                                                                                       | S <sub>2</sub>                   | = | 1695.86  |                 | $S1 < S < S2$ |           |
| Factored limit state stress                                                                                                                   | $\phi F_L$                       | = | 202.45   | MPa             |               | 3.4.15(2) |
| <b>3.4.17 Compression in components of beams (component under uniform compression), gross section - flat plates with both edges supported</b> |                                  |   |          |                 |               |           |
|                                                                                                                                               | k <sub>1</sub>                   | = | 0.5      |                 |               | T3.3(D)   |
|                                                                                                                                               | k <sub>2</sub>                   | = | 2.04     |                 |               | T3.3(D)   |
| Max. distance between toes of fillets of supporting elements for plate                                                                        | b'                               | = | 42       | mm              |               |           |
|                                                                                                                                               | t                                | = | 3        | mm              |               |           |
| Slenderness                                                                                                                                   | b/t                              | = | 14       |                 |               |           |
| Limit 1                                                                                                                                       | S <sub>1</sub>                   | = | 12.34    |                 |               |           |
| Limit 2                                                                                                                                       | S <sub>2</sub>                   | = | 46.95    |                 | $S1 < S < S2$ |           |
| Factored limit state stress                                                                                                                   | $\phi F_L$                       | = | 224.30   | MPa             |               |           |
| Most adverse in-plane bending limit state stress                                                                                              | F <sub>bx</sub>                  | = | 202.45   | MPa             |               |           |
| Most adverse in-plane bending capacity factor                                                                                                 | f <sub>bx</sub> /F <sub>bx</sub> | = | 0.35     |                 | PASS          |           |
| <b>BENDING - OUT-OF-PLANE</b>                                                                                                                 |                                  |   |          |                 |               |           |
| <b>NOTE: Limit state stresses, <math>\phi F_L</math> are the same for out-of-plane bending (doubly symmetric section)</b>                     |                                  |   |          |                 |               |           |
| Factored limit state stress                                                                                                                   | $\phi F_L$                       | = | 202.45   | MPa             |               |           |
| Most adverse out-of-plane bending limit state stress                                                                                          | F <sub>by</sub>                  | = | 202.45   | MPa             |               |           |
| Most adverse out-of-plane bending capacity factor                                                                                             | f <sub>by</sub> /F <sub>by</sub> | = | 0.13     |                 | PASS          |           |
| <b>COMBINED ACTIONS</b>                                                                                                                       |                                  |   |          |                 |               |           |
| <b>4.1.1 Combined compression and bending</b>                                                                                                 |                                  |   |          |                 |               |           |
|                                                                                                                                               |                                  |   |          |                 |               | 4.1.1(2)  |





## Civil & Structural Engineering Design Services Pty. Ltd.

|                                                           |   |        |        |                |               |
|-----------------------------------------------------------|---|--------|--------|----------------|---------------|
| $F_a$                                                     | = | 36.46  | MPa    |                | ... 3.4.8     |
| $F_{ao}$                                                  | = | 224.30 | MPa    |                | ... 3.4.10    |
| $F_{bx}$                                                  | = | 224.30 | MPa    |                | ... 3.4.17    |
| $F_{by}$                                                  | = | 202.45 | MPa    |                | ... 3.4.17    |
| $f_a/F_a$                                                 | = | 0.089  |        | Which is <0.15 |               |
| Check: $f_a/F_a + f_{bx}/F_{bx} + f_{by}/F_{by} \leq 1.0$ |   |        |        |                | ... 4.1.1 (3) |
| i.e.                                                      |   | 0.57   | $\leq$ | 1.0            | PASS          |

### 6.2 Rafter

| NAME                              | SYMBOL          | VALUE       | UNIT            | NOTES       | REF      |
|-----------------------------------|-----------------|-------------|-----------------|-------------|----------|
| <b>82x48x3</b>                    | <b>(Rafter)</b> |             |                 |             |          |
| Alloy and temper                  | 6061-T6         |             |                 |             | AS1664.1 |
| Tension                           | $F_{tu}$        | = 262       | MPa             | Ultimate    | T3.3(A)  |
|                                   | $F_{ty}$        | = 241       | MPa             | Yield       |          |
| Compression                       | $F_{cy}$        | = 241       | MPa             |             |          |
| Shear                             | $F_{su}$        | = 165       | MPa             | Ultimate    |          |
|                                   | $F_{sy}$        | = 138       | MPa             | Yield       |          |
| Bearing                           | $F_{bu}$        | = 551       | MPa             | Ultimate    |          |
|                                   | $F_{by}$        | = 386       | MPa             | Yield       |          |
| Modulus of elasticity             | E               | = 70000     | MPa             | Compressive |          |
|                                   | $k_t$           | = 1.0       |                 |             | T3.4(B)  |
|                                   | $k_c$           | = 1.0       |                 |             |          |
| <b>FEM ANALYSIS RESULTS</b>       |                 |             |                 |             |          |
| Axial force                       | P               | = 2         | kN              | compression |          |
| In plane moment                   | $M_x$           | = 1.07      | kNm             |             |          |
| Out of plane moment               | $M_y$           | = 0.35      | kNm             |             |          |
| <b>DESIGN STRESSES</b>            |                 |             |                 |             |          |
| Gross cross section area          | $A_g$           | = 744       | mm <sup>2</sup> |             |          |
| In-plane elastic section modulus  | $Z_x$           | = 16318.439 | mm <sup>3</sup> |             |          |
| Out-of-plane elastic section mod. | $Z_y$           | = 11937     | mm <sup>3</sup> |             |          |
| Stress from axial force           | $f_a$           | = $P/A_g$   |                 |             |          |
|                                   |                 | = 2.69      | MPa             | compression |          |



## Civil & Structural Engineering Design Services Pty. Ltd.

|                                                                                                               |             |   |               |            |                   |                      |
|---------------------------------------------------------------------------------------------------------------|-------------|---|---------------|------------|-------------------|----------------------|
| Stress from in-plane bending                                                                                  | $f_{bx}$    | = | $M_x/Z_x$     |            |                   |                      |
|                                                                                                               |             | = | <b>65.57</b>  | <b>MPa</b> | compression       |                      |
| Stress from out-of-plane bending                                                                              | $f_{by}$    | = | $M_y/Z_y$     |            |                   |                      |
|                                                                                                               |             | = | <b>29.32</b>  | <b>MPa</b> | compression       |                      |
| <b>COMPRESSION</b>                                                                                            |             |   |               |            |                   |                      |
| <b>3.4.8 Compression in columns, axial, gross section</b>                                                     |             |   |               |            |                   |                      |
| <b>1. General</b>                                                                                             |             |   |               |            |                   | ... 3.4.8.1          |
| Unsupported length of member                                                                                  | L           | = | 4790          | mm         |                   |                      |
| Effective length factor                                                                                       | k           | = | 1             |            |                   |                      |
| Radius of gyration about buckling axis                                                                        | r           | = | 19.62         | mm         |                   |                      |
| Slenderness ratio                                                                                             | $kL/r$      | = | 244.10        |            |                   |                      |
| Slenderness parameter                                                                                         | $\lambda$   | = | 4.559         |            |                   |                      |
|                                                                                                               | $D_c^*$     | = | 90.3          |            |                   |                      |
|                                                                                                               | $S_1^*$     | = | 0.33          |            |                   |                      |
|                                                                                                               | $S_2^*$     | = | 1.23          |            |                   |                      |
|                                                                                                               | $\phi_{cc}$ | = | 0.950         |            |                   |                      |
| Factored limit state stress                                                                                   | $\phi F_L$  | = | <b>11.01</b>  | <b>MPa</b> |                   |                      |
| <b>2. Sections not subject to torsional or torsional-flexural buckling</b>                                    |             |   |               |            |                   | ... 3.4.8.2          |
| Largest slenderness ratio for flexural buckling                                                               | $kL/r$      | = | 244.10        |            |                   |                      |
| <b>3.4.10 Uniform compression in components of columns, gross section - flat plates</b>                       |             |   |               |            |                   |                      |
| <b>1. Uniform compression in components of columns, gross section - flat plates with both edges supported</b> |             |   |               |            |                   | ... 3.4.10.1 T3.3(D) |
|                                                                                                               | $k_1$       | = | 0.35          |            |                   |                      |
| Max. distance between toes of fillets of supporting elements for plate                                        | $b'$        | = | 42            |            |                   |                      |
|                                                                                                               | t           | = | 3             | mm         |                   |                      |
| Slenderness                                                                                                   | $b/t$       | = | 14            |            |                   |                      |
| Limit 1                                                                                                       | $S_1$       | = | 12.34         |            |                   |                      |
| Limit 2                                                                                                       | $S_2$       | = | 32.87         |            | $S_1 < b/t < S_2$ |                      |
| Factored limit state stress                                                                                   | $\phi F_L$  | = | <b>224.30</b> | <b>MPa</b> |                   |                      |
| Most adverse compressive limit state stress                                                                   | $F_a$       | = | 11.01         | MPa        |                   |                      |



## Civil & Structural Engineering Design Services Pty. Ltd.

|                                                                                                                                               |                 |   |                          |                 |           |
|-----------------------------------------------------------------------------------------------------------------------------------------------|-----------------|---|--------------------------|-----------------|-----------|
| Most adverse compressive capacity factor                                                                                                      | $f_a/F_a$       | = | 0.24                     | PASS            |           |
| <b>BENDING - IN-PLANE</b>                                                                                                                     |                 |   |                          |                 |           |
| <b>3.4.15</b> Compression in beams, extreme fibre, gross section rectangular tubes, box sections                                              |                 |   |                          |                 |           |
| Unbraced length for bending                                                                                                                   | $L_b$           | = | 1600 mm                  |                 |           |
| Second moment of area (weak axis)                                                                                                             | $I_y$           | = | 2.86E+05 mm <sup>4</sup> |                 |           |
| Torsion modulus                                                                                                                               | $J$             | = | 6.12E+05 mm <sup>3</sup> |                 |           |
| Elastic section modulus                                                                                                                       | $Z$             | = | 11937 mm <sup>3</sup>    |                 |           |
| Slenderness                                                                                                                                   | $S$             | = | 91.26                    |                 |           |
| Limit 1                                                                                                                                       | $S_1$           | = | 0.39                     |                 |           |
| Limit 2                                                                                                                                       | $S_2$           | = | 1695.86                  | $S_1 < S < S_2$ |           |
| Factored limit state stress                                                                                                                   | $\phi F_L$      | = | 208.47 MPa               |                 | 3.4.15(2) |
| <b>3.4.17</b> Compression in components of beams (component under uniform compression), gross section - flat plates with both edges supported |                 |   |                          |                 |           |
|                                                                                                                                               | $k_1$           | = | 0.5                      |                 | T3.3(D)   |
|                                                                                                                                               | $k_2$           | = | 2.04                     |                 | T3.3(D)   |
| Max. distance between toes of fillets of supporting elements for plate                                                                        | $b'$            | = | 42 mm                    |                 |           |
|                                                                                                                                               | $t$             | = | 3 mm                     |                 |           |
| Slenderness                                                                                                                                   | $b/t$           | = | 14                       |                 |           |
| Limit 1                                                                                                                                       | $S_1$           | = | 12.34                    |                 |           |
| Limit 2                                                                                                                                       | $S_2$           | = | 46.95                    | $S_1 < S < S_2$ |           |
| Factored limit state stress                                                                                                                   | $\phi F_L$      | = | 224.30 MPa               |                 |           |
| Most adverse in-plane bending limit state stress                                                                                              | $F_{bx}$        | = | 208.47 MPa               |                 |           |
| Most adverse in-plane bending capacity factor                                                                                                 | $f_{bx}/F_{bx}$ | = | 0.31                     | PASS            |           |
| <b>BENDING - OUT-OF-PLANE</b>                                                                                                                 |                 |   |                          |                 |           |
| NOTE: Limit state stresses, $\phi F_L$ are the same for out-of-plane bending (doubly symmetric section)                                       |                 |   |                          |                 |           |
| Factored limit state stress                                                                                                                   | $\phi F_L$      | = | 208.47 MPa               |                 |           |



## Civil & Structural Engineering Design Services Pty. Ltd.

|                                                      |                                                    |   |        |     |                |               |
|------------------------------------------------------|----------------------------------------------------|---|--------|-----|----------------|---------------|
| Most adverse out-of-plane bending limit state stress | $F_{by}$                                           | = | 208.47 | MPa |                |               |
| Most adverse out-of-plane bending capacity factor    | $f_{by}/F_{by}$                                    | = | 0.14   |     | PASS           |               |
| COMBINED ACTIONS                                     |                                                    |   |        |     |                |               |
| <b>4.1.1 Combined compression and bending</b>        |                                                    |   |        |     |                |               |
|                                                      | $F_a$                                              | = | 11.01  | MPa |                | ... 4.1.1(2)  |
|                                                      | $F_{ao}$                                           | = | 224.30 | MPa |                | ... 3.4.8     |
|                                                      | $F_{bx}$                                           | = | 224.30 | MPa |                | ... 3.4.10    |
|                                                      | $F_{by}$                                           | = | 208.47 | MPa |                | ... 3.4.17    |
|                                                      | $f_a/F_a$                                          | = | 0.244  |     | Which is <0.15 | ... 3.4.17    |
| Check:                                               | $f_a/F_a + f_{bx}/F_{bx} + f_{by}/F_{by} \leq 1.0$ |   |        |     |                | ... 4.1.1 (3) |
| i.e.                                                 | 0.70                                               | ≤ | 1.0    |     | PASS           |               |

### 6.3 Gable Pole

| NAME                  | SYMBOL          |   | VALUE | UNIT | NOTES       | REF      |
|-----------------------|-----------------|---|-------|------|-------------|----------|
| 82x48x3               | (Gable pole)    |   |       |      |             |          |
| Alloy and temper      | 6061-T6         |   |       |      |             | AS1664.1 |
| Tension               | F <sub>tu</sub> | = | 262   | MPa  | Ultimate    | T3.3(A)  |
|                       | F <sub>ty</sub> | = | 241   | MPa  | Yield       |          |
| Compression           | F <sub>cy</sub> | = | 241   | MPa  |             |          |
| Shear                 | F <sub>su</sub> | = | 165   | MPa  | Ultimate    |          |
|                       | F <sub>sy</sub> | = | 138   | MPa  | Yield       |          |
| Bearing               | F <sub>bu</sub> | = | 551   | MPa  | Ultimate    |          |
|                       | F <sub>by</sub> | = | 386   | MPa  | Yield       |          |
| Modulus of elasticity | E               | = | 70000 | MPa  | Compressive |          |
|                       | k <sub>t</sub>  | = | 1.0   |      |             | T3.4(B)  |
|                       | k <sub>c</sub>  | = | 1.0   |      |             |          |
| FEM ANALYSIS RESULTS  |                 |   |       |      |             |          |
| Axial force           | P               | = | 1.9   | kN   | compression |          |
| In plane moment       | M <sub>x</sub>  | = | 1.4   | kNm  |             |          |
| Out of plane moment   | M <sub>y</sub>  | = | 0.9   | kNm  |             |          |



## Civil & Structural Engineering Design Services Pty. Ltd.

| DESIGN STRESSES                                                                                        |             |   |                           |             |              |
|--------------------------------------------------------------------------------------------------------|-------------|---|---------------------------|-------------|--------------|
| Gross cross section area                                                                               | $A_g$       | = | 744 mm <sup>2</sup>       |             |              |
| In-plane elastic section modulus                                                                       | $Z_x$       | = | 16318.439 mm <sup>3</sup> |             |              |
| Out-of-plane elastic section mod.                                                                      | $Z_y$       | = | 11937 mm <sup>3</sup>     |             |              |
| Stress from axial force                                                                                | $f_a$       | = | $P/A_g$                   |             |              |
|                                                                                                        |             | = | <b>2.55 MPa</b>           | compression |              |
| Stress from in-plane bending                                                                           | $f_{bx}$    | = | $M_x/Z_x$                 |             |              |
|                                                                                                        |             | = | <b>85.79 MPa</b>          | compression |              |
| Stress from out-of-plane bending                                                                       | $f_{by}$    | = | $M_y/Z_y$                 |             |              |
|                                                                                                        |             | = | <b>75.40 MPa</b>          | compression |              |
| COMPRESSION                                                                                            |             |   |                           |             |              |
| <b>3.4.8</b> Compression in columns, axial, gross section                                              |             |   |                           |             |              |
| 1. General                                                                                             |             |   |                           |             | ... 3.4.8.1  |
| Unsupported length of member                                                                           | $L$         | = | 4420 mm                   |             |              |
| Effective length factor                                                                                | $k$         | = | 1                         |             |              |
| Radius of gyration about buckling axis                                                                 | $r$         | = | 19.62 mm                  |             |              |
| Slenderness ratio                                                                                      | $kL/r$      | = | 225.25                    |             |              |
| Slenderness parameter                                                                                  | $\lambda$   | = | 4.21                      |             |              |
|                                                                                                        | $D_c^*$     | = | 90.3                      |             |              |
|                                                                                                        | $S_1^*$     | = | 0.33                      |             |              |
|                                                                                                        | $S_2^*$     | = | 1.23                      |             |              |
|                                                                                                        | $\phi_{cc}$ | = | 0.950                     |             |              |
| Factored limit state stress                                                                            | $\phi F_L$  | = | <b>12.94 MPa</b>          |             |              |
| 2. Sections not subject to torsional or torsional-flexural buckling                                    |             |   |                           |             | ... 3.4.8.2  |
| Largest slenderness ratio for flexural buckling                                                        | $kL/r$      | = | 225.25                    |             |              |
| <b>3.4.10</b> Uniform compression in components of columns, gross section - flat plates                |             |   |                           |             |              |
| 1. Uniform compression in components of columns, gross section - flat plates with both edges supported |             |   |                           |             | ... 3.4.10.1 |
|                                                                                                        | $k_1$       | = | 0.35                      |             | T3.3(D)      |
| Max. distance between toes of fillets of supporting elements for plate                                 | $b'$        | = | 42                        |             |              |



## Civil & Structural Engineering Design Services Pty. Ltd.

|                                                                                                                                               |            |   |           |                 |                 |           |
|-----------------------------------------------------------------------------------------------------------------------------------------------|------------|---|-----------|-----------------|-----------------|-----------|
| Slenderness                                                                                                                                   | $t$        | = | 3         | mm              |                 |           |
| Limit 1                                                                                                                                       | $b/t$      | = | 14        |                 |                 |           |
| Limit 2                                                                                                                                       | $S_1$      | = | 12.34     |                 | $S1 < b/t < S2$ |           |
| Factored limit state stress                                                                                                                   | $S_2$      | = | 32.87     |                 |                 |           |
| Most adverse compressive limit state stress                                                                                                   | $\phi F_L$ | = | 224.30    | MPa             |                 |           |
| Most adverse compressive capacity factor                                                                                                      | $F_a$      | = | 12.94     | MPa             |                 |           |
|                                                                                                                                               | $f_a/F_a$  | = | 0.20      |                 | PASS            |           |
| <b>BENDING - IN-PLANE</b>                                                                                                                     |            |   |           |                 |                 |           |
| <b>3.4.15</b> Compression in beams, extreme fibre, gross section rectangular tubes, box sections                                              |            |   |           |                 |                 |           |
| Unbraced length for bending                                                                                                                   | $L_b$      | = | 2600      | mm              |                 |           |
| Second moment of area (weak axis)                                                                                                             | $I_y$      | = | 286488    | mm <sup>4</sup> |                 |           |
| Torsion modulus                                                                                                                               | $J$        | = | 611517.34 | mm <sup>3</sup> |                 |           |
| Elastic section modulus                                                                                                                       | $Z$        | = | 11937     | mm <sup>3</sup> |                 |           |
| Slenderness                                                                                                                                   | $S$        | = | 148.30    |                 |                 |           |
| Limit 1                                                                                                                                       | $S_1$      | = | 0.39      |                 | $S1 < S < S2$   |           |
| Limit 2                                                                                                                                       | $S_2$      | = | 1695.86   |                 |                 |           |
| Factored limit state stress                                                                                                                   | $\phi F_L$ | = | 202.45    | MPa             |                 | 3.4.15(2) |
| <b>3.4.17</b> Compression in components of beams (component under uniform compression), gross section - flat plates with both edges supported |            |   |           |                 |                 |           |
|                                                                                                                                               | $k_1$      | = | 0.5       |                 |                 | T3.3(D)   |
|                                                                                                                                               | $k_2$      | = | 2.04      |                 |                 | T3.3(D)   |
| Max. distance between toes of fillets of supporting elements for plate                                                                        | $b'$       | = | 42        | mm              |                 |           |
| Slenderness                                                                                                                                   | $t$        | = | 3         | mm              |                 |           |
| Limit 1                                                                                                                                       | $b/t$      | = | 14        |                 |                 |           |
| Limit 2                                                                                                                                       | $S_1$      | = | 12.34     |                 | $S1 < S < S2$   |           |
| Factored limit state stress                                                                                                                   | $S_2$      | = | 46.95     |                 |                 |           |
|                                                                                                                                               | $\phi F_L$ | = | 224.30    | MPa             |                 |           |



## Civil & Structural Engineering Design Services Pty. Ltd.

|                                                                                                                           |                                                    |   |        |     |                |               |
|---------------------------------------------------------------------------------------------------------------------------|----------------------------------------------------|---|--------|-----|----------------|---------------|
| Most adverse in-plane bending limit state stress                                                                          | $F_{bx}$                                           | = | 202.45 | MPa |                |               |
| Most adverse in-plane bending capacity factor                                                                             | $f_{bx}/F_{bx}$                                    | = | 0.42   |     | PASS           |               |
| <b>BENDING - OUT-OF-PLANE</b>                                                                                             |                                                    |   |        |     |                |               |
| <i>NOTE: Limit state stresses, <math>\phi F_L</math> are the same for out-of-plane bending (doubly symmetric section)</i> |                                                    |   |        |     |                |               |
| Factored limit state stress                                                                                               | $\phi F_L$                                         | = | 202.45 | MPa |                |               |
| Most adverse out-of-plane bending limit state stress                                                                      | $F_{by}$                                           | = | 202.45 | MPa |                |               |
| Most adverse out-of-plane bending capacity factor                                                                         | $f_{by}/F_{by}$                                    | = | 0.37   |     | PASS           |               |
| <b>COMBINED ACTIONS</b>                                                                                                   |                                                    |   |        |     |                |               |
| <b>4.1.1 Combined compression and bending</b>                                                                             |                                                    |   |        |     |                |               |
|                                                                                                                           | $F_a$                                              | = | 12.94  | MPa |                | 4.1.1(2)      |
|                                                                                                                           | $F_{ao}$                                           | = | 224.30 | MPa |                | ... 3.4.8     |
|                                                                                                                           | $F_{bx}$                                           | = | 224.30 | MPa |                | ... 3.4.10    |
|                                                                                                                           | $F_{by}$                                           | = | 202.45 | MPa |                | ... 3.4.17    |
|                                                                                                                           | $f_a/F_a$                                          | = | 0.197  |     | Which is <0.15 | ... 3.4.17    |
| Check:                                                                                                                    | $f_a/F_a + f_{bx}/F_{bx} + f_{by}/F_{by} \leq 1.0$ |   |        |     |                | ... 4.1.1 (3) |
| i.e.                                                                                                                      | 0.99                                               | ≤ | 1.0    |     | PASS           |               |

### 6.4 Ridge & Eave Purlin

| NAME             | SYMBOL                           | VALUE | UNIT | NOTES | REF      |
|------------------|----------------------------------|-------|------|-------|----------|
| <b>40x40x2</b>   | <b>(Ridge &amp; Eave Purlin)</b> |       |      |       |          |
| Alloy and temper | 6061-T6                          |       |      |       | AS1664.1 |
| Tension          | $F_{tu}$                         | =     | 262  | MPa   | T3.3(A)  |
|                  | $F_{ty}$                         | =     | 241  | MPa   |          |
| Compression      | $F_{cy}$                         | =     | 241  | MPa   |          |
| Shear            | $F_{su}$                         | =     | 165  | MPa   | Ultimate |
|                  | $F_{sy}$                         | =     | 138  | MPa   | Yield    |
| Bearing          | $F_{bu}$                         | =     | 551  | MPa   | Ultimate |
|                  | $F_{by}$                         | =     | 386  | MPa   | Yield    |



## Civil & Structural Engineering Design Services Pty. Ltd.

|                                                           |             |   |                           |                 |             |         |
|-----------------------------------------------------------|-------------|---|---------------------------|-----------------|-------------|---------|
| Modulus of elasticity                                     | $E$         | = | 70000                     | MPa             | Compressive |         |
|                                                           | $k_t$       | = | 1.0                       |                 |             | T3.4(B) |
|                                                           | $k_c$       | = | 1.0                       |                 |             |         |
| <b>FEM ANALYSIS RESULTS</b>                               |             |   |                           |                 |             |         |
| Axial force                                               | $P$         | = | 2.6                       | kN              | compression |         |
| In plane moment                                           | $M_x$       | = | 0.26                      | kNm             |             |         |
| Out of plane moment                                       | $M_y$       | = | 0.01                      | kNm             |             |         |
| <b>DESIGN STRESSES</b>                                    |             |   |                           |                 |             |         |
| Gross cross section area                                  | $A_g$       | = | 304                       | mm <sup>2</sup> |             |         |
| In-plane elastic section modulus                          | $Z_x$       | = | 3668.266<br>7             | mm <sup>3</sup> |             |         |
| Out-of-plane elastic section mod.                         | $Z_y$       | = | 3668.266<br>7             | mm <sup>3</sup> |             |         |
| Stress from axial force                                   | $f_a$       | = | $P/A_g$<br><b>8.55</b>    | <b>MPa</b>      | compression |         |
| Stress from in-plane bending                              | $f_{bx}$    | = | $M_x/Z_x$<br><b>70.88</b> | <b>MPa</b>      | compression |         |
| Stress from out-of-plane bending                          | $f_{by}$    | = | $M_y/Z_y$<br><b>2.73</b>  | <b>MPa</b>      | compression |         |
| <b>COMPRESSION</b>                                        |             |   |                           |                 |             |         |
| <b>3.4.8 Compression in columns, axial, gross section</b> |             |   |                           |                 |             |         |
| <b>1. General</b>                                         |             |   |                           |                 |             |         |
| Unsupported length of member                              | $L$         | = | 3000                      | mm              |             |         |
| Effective length factor                                   | $k$         | = | 1                         |                 |             |         |
| Radius of gyration about buckling axis                    | $r$         | = | 15.53                     | mm              |             |         |
| Slenderness ratio                                         | $kL/r$      | = | 193.11                    |                 |             |         |
| Slenderness parameter                                     | $\lambda$   | = | 3.61                      |                 |             |         |
|                                                           | $D_c^*$     | = | 90.3                      |                 |             |         |
|                                                           | $S_1^*$     | = | 0.33                      |                 |             |         |
|                                                           | $S_2^*$     | = | 1.23                      |                 |             |         |
|                                                           | $\phi_{cc}$ | = | 0.950                     |                 |             |         |
| Factored limit state stress                               | $\phi F_L$  | = | 17.60                     | MPa             |             |         |





## Civil & Structural Engineering Design Services Pty. Ltd.

|                                                                                                                                               |            |   |          |                   |                  |
|-----------------------------------------------------------------------------------------------------------------------------------------------|------------|---|----------|-------------------|------------------|
| 2. Sections not subject to torsional or torsional-flexural buckling                                                                           |            |   |          |                   | ... 3.4.8.2      |
| Largest slenderness ratio for flexural buckling                                                                                               | $kL/r$     | = | 193.11   |                   |                  |
| <b>3.4.10</b> Uniform compression in components of columns, gross section - flat plates                                                       |            |   |          |                   |                  |
| 1. Uniform compression in components of columns, gross section - flat plates with both edges supported                                        |            |   |          |                   | ...<br>3.4.10.1  |
|                                                                                                                                               | $k_1$      | = | 0.35     |                   | T3.3(D)          |
| Max. distance between toes of fillets of supporting elements for plate                                                                        | $b'$       | = | 36       |                   |                  |
|                                                                                                                                               | $t$        | = | 2        | mm                |                  |
| Slenderness                                                                                                                                   | $b/t$      | = | 18       |                   |                  |
| Limit 1                                                                                                                                       | $S_1$      | = | 12.34    |                   |                  |
| Limit 2                                                                                                                                       | $S_2$      | = | 32.87    | $S_1 < b/t < S_2$ |                  |
| Factored limit state stress                                                                                                                   | $\phi F_L$ | = | 213.07   | MPa               |                  |
| Most adverse compressive limit state stress                                                                                                   | $F_a$      | = | 17.60    | MPa               |                  |
| Most adverse compressive capacity factor                                                                                                      | $f_a/F_a$  | = | 0.49     | PASS              |                  |
| <b>BENDING - IN-PLANE</b>                                                                                                                     |            |   |          |                   |                  |
| <b>3.4.15</b> Compression in beams, extreme fibre, gross section rectangular tubes, box sections                                              |            |   |          |                   |                  |
| Unbraced length for bending                                                                                                                   | $L_b$      | = | 3000     | mm                |                  |
| Second moment of area (weak axis)                                                                                                             | $I_y$      | = | 73365.33 | mm <sup>4</sup>   |                  |
|                                                                                                                                               |            |   | 3        |                   |                  |
| Torsion modulus                                                                                                                               | $J$        | = | 109744   | mm <sup>3</sup>   |                  |
| Elastic section modulus                                                                                                                       | $Z$        | = | 3668.266 | mm <sup>3</sup>   |                  |
|                                                                                                                                               |            |   | 7        |                   |                  |
| Slenderness                                                                                                                                   | $S$        | = | 245.29   |                   |                  |
| Limit 1                                                                                                                                       | $S_1$      | = | 0.39     |                   |                  |
| Limit 2                                                                                                                                       | $S_2$      | = | 1695.86  | $S_1 < S < S_2$   |                  |
| Factored limit state stress                                                                                                                   | $\phi F_L$ | = | 194.46   | MPa               | ...<br>3.4.15(2) |
| <b>3.4.17</b> Compression in components of beams (component under uniform compression), gross section - flat plates with both edges supported |            |   |          |                   |                  |



## Civil & Structural Engineering Design Services Pty. Ltd.

|                                                                                                                           |                                                    |        |        |     |                |               |
|---------------------------------------------------------------------------------------------------------------------------|----------------------------------------------------|--------|--------|-----|----------------|---------------|
|                                                                                                                           | $k_1$                                              | =      | 0.5    |     |                | T3.3(D)       |
|                                                                                                                           | $k_2$                                              | =      | 2.04   |     |                | T3.3(D)       |
| Max. distance between toes of fillets of supporting elements for plate                                                    | $b'$                                               | =      | 36     | mm  |                |               |
| Slenderness                                                                                                               | $t$                                                | =      | 2      | mm  |                |               |
| Limit 1                                                                                                                   | $b/t$                                              | =      | 18     |     |                |               |
| Limit 2                                                                                                                   | $S_1$                                              | =      | 12.34  |     |                |               |
|                                                                                                                           | $S_2$                                              | =      | 46.95  |     | $S1 < S < S2$  |               |
| Factored limit state stress                                                                                               | $\phi F_L$                                         | =      | 213.07 | MPa |                |               |
| Most adverse in-plane bending limit state stress                                                                          | $F_{bx}$                                           | =      | 194.46 | MPa |                |               |
| Most adverse in-plane bending capacity factor                                                                             | $f_{bx}/F_{bx}$                                    | =      | 0.36   |     | PASS           |               |
| <b>BENDING - OUT-OF-PLANE</b>                                                                                             |                                                    |        |        |     |                |               |
| <i>NOTE: Limit state stresses, <math>\phi F_L</math> are the same for out-of-plane bending (doubly symmetric section)</i> |                                                    |        |        |     |                |               |
| Factored limit state stress                                                                                               | $\phi F_L$                                         | =      | 194.46 | MPa |                |               |
| Most adverse out-of-plane bending limit state stress                                                                      | $F_{by}$                                           | =      | 194.46 | MPa |                |               |
| Most adverse out-of-plane bending capacity factor                                                                         | $f_{by}/F_{by}$                                    | =      | 0.01   |     | PASS           |               |
| <b>COMBINED ACTIONS</b>                                                                                                   |                                                    |        |        |     |                |               |
| <b>4.1.1 Combined compression and bending</b>                                                                             |                                                    |        |        |     |                | ...           |
|                                                                                                                           | $F_a$                                              | =      | 17.60  | MPa |                | 4.1.1(2)      |
|                                                                                                                           | $F_{ao}$                                           | =      | 213.07 | MPa |                | ... 3.4.8     |
|                                                                                                                           | $F_{bx}$                                           | =      | 213.07 | MPa |                | ... 3.4.10    |
|                                                                                                                           | $F_{by}$                                           | =      | 194.46 | MPa |                | ... 3.4.17    |
|                                                                                                                           | $f_a/F_a$                                          | =      | 0.486  |     | Which is <0.15 | ... 3.4.17    |
| Check:                                                                                                                    | $f_a/F_a + f_{bx}/F_{bx} + f_{by}/F_{by} \leq 1.0$ |        |        |     |                | ... 4.1.1 (3) |
| i.e.                                                                                                                      | 0.86                                               | $\leq$ | 1.0    |     | PASS           |               |



## Civil & Structural Engineering Design Services Pty. Ltd.

### 6.5 Gable Beam

| NAME                                                      | SYMBOL              | VALUE       | UNIT            | NOTES       | REF         |
|-----------------------------------------------------------|---------------------|-------------|-----------------|-------------|-------------|
| <b>40x40x2</b>                                            | <b>(Gable Beam)</b> |             |                 |             |             |
| Alloy and temper                                          | 6061-T6             |             |                 |             | AS1664.1    |
| Tension                                                   | $F_{tu}$            | = 262       | MPa             | Ultimate    | T3.3(A)     |
|                                                           | $F_{ty}$            | = 241       | MPa             | Yield       |             |
| Compression                                               | $F_{cy}$            | = 241       | MPa             |             |             |
| Shear                                                     | $F_{su}$            | = 165       | MPa             | Ultimate    |             |
|                                                           | $F_{sy}$            | = 138       | MPa             | Yield       |             |
| Bearing                                                   | $F_{bu}$            | = 551       | MPa             | Ultimate    |             |
|                                                           | $F_{by}$            | = 386       | MPa             | Yield       |             |
| Modulus of elasticity                                     | E                   | = 70000     | MPa             | Compressive |             |
|                                                           | $k_t$               | = 1.0       |                 |             | T3.4(B)     |
|                                                           | $k_c$               | = 1.0       |                 |             |             |
| <b>FEM ANALYSIS RESULTS</b>                               |                     |             |                 |             |             |
| Axial force                                               | P                   | = 3.87      | kN              | compression |             |
| In plane moment                                           | $M_x$               | = 0.08      | kNm             |             |             |
| Out of plane moment                                       | $M_y$               | = 0.08      | kNm             |             |             |
| <b>DESIGN STRESSES</b>                                    |                     |             |                 |             |             |
| Gross cross section area                                  | $A_g$               | = 304       | mm <sup>2</sup> |             |             |
| In-plane elastic section modulus                          | $Z_x$               | = 3668.2667 | mm <sup>3</sup> |             |             |
| Out-of-plane elastic section mod.                         | $Z_y$               | = 3668.2667 | mm <sup>3</sup> |             |             |
| Stress from axial force                                   | $f_a$               | = $P/A_g$   |                 |             |             |
|                                                           |                     | = 12.73     | MPa             | compression |             |
| Stress from in-plane bending                              | $f_{bx}$            | = $M_x/Z_x$ |                 |             |             |
|                                                           |                     | = 21.81     | MPa             | compression |             |
| Stress from out-of-plane bending                          | $f_{by}$            | = $M_y/Z_y$ |                 |             |             |
|                                                           |                     | = 21.81     | MPa             | compression |             |
| <b>COMPRESSION</b>                                        |                     |             |                 |             |             |
| <b>3.4.8 Compression in columns, axial, gross section</b> |                     |             |                 |             |             |
| <b>1. General</b>                                         |                     |             |                 |             |             |
| Unsupported length of                                     | L                   | = 3000      | mm              |             | ... 3.4.8.1 |



## Civil & Structural Engineering Design Services Pty. Ltd.

|                                                                                                        |             |   |           |                 |                   |                 |
|--------------------------------------------------------------------------------------------------------|-------------|---|-----------|-----------------|-------------------|-----------------|
| member                                                                                                 |             |   |           |                 |                   |                 |
| Effective length factor                                                                                | $k$         | = | 1         |                 |                   |                 |
| Radius of gyration about buckling axis                                                                 | $r$         | = | 15.53     | mm              |                   |                 |
| Slenderness ratio                                                                                      | $kL/r$      | = | 193.11    |                 |                   |                 |
| Slenderness parameter                                                                                  | $\lambda$   | = | 3.61      |                 |                   |                 |
|                                                                                                        | $D_c^*$     | = | 90.3      |                 |                   |                 |
|                                                                                                        | $S_1^*$     | = | 0.33      |                 |                   |                 |
|                                                                                                        | $S_2^*$     | = | 1.23      |                 |                   |                 |
|                                                                                                        | $\phi_{cc}$ | = | 0.950     |                 |                   |                 |
| Factored limit state stress                                                                            | $\phi F_L$  | = | 17.60     | MPa             |                   |                 |
| 2. Sections not subject to torsional or torsional-flexural buckling                                    |             |   |           |                 |                   | ... 3.4.8.2     |
| Largest slenderness ratio for flexural buckling                                                        | $kL/r$      | = | 193.11    |                 |                   |                 |
| <b>3.4.10</b> Uniform compression in components of columns, gross section - flat plates                |             |   |           |                 |                   |                 |
| 1. Uniform compression in components of columns, gross section - flat plates with both edges supported |             |   |           |                 |                   | ...<br>3.4.10.1 |
|                                                                                                        | $k_1$       | = | 0.35      |                 |                   | T3.3(D)         |
| Max. distance between toes of fillets of supporting elements for plate                                 | $b'$        | = | 36        |                 |                   |                 |
|                                                                                                        | $t$         | = | 2         | mm              |                   |                 |
| Slenderness                                                                                            | $b/t$       | = | 18        |                 |                   |                 |
| Limit 1                                                                                                | $S_1$       | = | 12.34     |                 |                   |                 |
| Limit 2                                                                                                | $S_2$       | = | 32.87     |                 | $S_1 < b/t < S_2$ |                 |
| Factored limit state stress                                                                            | $\phi F_L$  | = | 213.07    | MPa             |                   |                 |
| Most adverse compressive limit state stress                                                            | $F_a$       | = | 17.60     | MPa             |                   |                 |
| Most adverse compressive capacity factor                                                               | $f_d/F_a$   | = | 0.72      |                 | PASS              |                 |
| <b>BENDING - IN-PLANE</b>                                                                              |             |   |           |                 |                   |                 |
| <b>3.4.15</b> Compression in beams, extreme fibre, gross section rectangular tubes, box sections       |             |   |           |                 |                   |                 |
| Unbraced length for bending                                                                            | $L_b$       | = | 3000      | mm              |                   |                 |
| Second moment of area (weak axis)                                                                      | $I_y$       | = | 73365.333 | mm <sup>4</sup> |                   |                 |



## Civil & Structural Engineering Design Services Pty. Ltd.

|                                                                                                                                               |                                  |   |           |                 |             |           |
|-----------------------------------------------------------------------------------------------------------------------------------------------|----------------------------------|---|-----------|-----------------|-------------|-----------|
| Torsion modulus                                                                                                                               | J                                | = | 109744    | mm <sup>3</sup> |             |           |
| Elastic section modulus                                                                                                                       | Z                                | = | 3668.2667 | mm <sup>3</sup> |             |           |
| Slenderness                                                                                                                                   | S                                | = | 245.29    |                 |             |           |
| Limit 1                                                                                                                                       | S <sub>1</sub>                   | = | 0.39      |                 |             |           |
| Limit 2                                                                                                                                       | S <sub>2</sub>                   | = | 1695.86   |                 | S1 < S < S2 |           |
| Factored limit state stress                                                                                                                   | $\phi F_L$                       | = | 194.46    | MPa             |             | 3.4.15(2) |
| <b>3.4.17 Compression in components of beams (component under uniform compression), gross section - flat plates with both edges supported</b> |                                  |   |           |                 |             |           |
|                                                                                                                                               | k <sub>1</sub>                   | = | 0.5       |                 |             | T3.3(D)   |
|                                                                                                                                               | k <sub>2</sub>                   | = | 2.04      |                 |             | T3.3(D)   |
| Max. distance between toes of fillets of supporting elements for plate                                                                        | b'                               | = | 36        | mm              |             |           |
|                                                                                                                                               | t                                | = | 2         | mm              |             |           |
| Slenderness                                                                                                                                   | b/t                              | = | 18        |                 |             |           |
| Limit 1                                                                                                                                       | S <sub>1</sub>                   | = | 12.34     |                 |             |           |
| Limit 2                                                                                                                                       | S <sub>2</sub>                   | = | 46.95     |                 | S1 < S < S2 |           |
| Factored limit state stress                                                                                                                   | $\phi F_L$                       | = | 213.07    | MPa             |             |           |
| Most adverse in-plane bending limit state stress                                                                                              | F <sub>bx</sub>                  | = | 194.46    | MPa             |             |           |
| Most adverse in-plane bending capacity factor                                                                                                 | f <sub>bx</sub> /F <sub>bx</sub> | = | 0.11      |                 | PASS        |           |
| <b>BENDING - OUT-OF-PLANE</b>                                                                                                                 |                                  |   |           |                 |             |           |
| <i>NOTE: Limit state stresses, <math>\phi F_L</math> are the same for out-of-plane bending (doubly symmetric section)</i>                     |                                  |   |           |                 |             |           |
| Factored limit state stress                                                                                                                   | $\phi F_L$                       | = | 194.46    | MPa             |             |           |
| Most adverse out-of-plane bending limit state stress                                                                                          | F <sub>by</sub>                  | = | 194.46    | MPa             |             |           |
| Most adverse out-of-plane bending capacity factor                                                                                             | f <sub>by</sub> /F <sub>by</sub> | = | 0.11      |                 | PASS        |           |
| <b>COMBINED ACTIONS</b>                                                                                                                       |                                  |   |           |                 |             |           |
| <b>4.1.1 Combined compression and bending</b>                                                                                                 |                                  |   |           |                 |             |           |
|                                                                                                                                               |                                  |   |           |                 |             | 4.1.1(2)  |



## Civil & Structural Engineering Design Services Pty. Ltd.

|                                                           |      |        |     |                |               |
|-----------------------------------------------------------|------|--------|-----|----------------|---------------|
| $F_a$                                                     | =    | 17.60  | MPa |                | ... 3.4.8     |
| $F_{ao}$                                                  | =    | 213.07 | MPa |                | ... 3.4.10    |
| $F_{bx}$                                                  | =    | 213.07 | MPa |                | ... 3.4.17    |
| $F_{by}$                                                  | =    | 194.46 | MPa |                | ... 3.4.17    |
| $f_a/F_a$                                                 | =    | 0.723  |     | Which is <0.15 |               |
| Check: $f_a/F_a + f_{bx}/F_{bx} + f_{by}/F_{by} \leq 1.0$ |      |        |     |                | ... 4.1.1 (3) |
| i.e.                                                      | 0.95 | ≤      | 1.0 | PASS           |               |

### 6.6 Intermediate Purlin

| NAME                              | SYMBOL                       | VALUE       | UNIT            | NOTES       | REF      |
|-----------------------------------|------------------------------|-------------|-----------------|-------------|----------|
| <b>40x40x2</b>                    | <b>(Intermediate Purlin)</b> |             |                 |             |          |
| Alloy and temper                  | 6061-T6                      |             |                 |             | AS1664.1 |
| Tension                           | $F_{tu}$                     | = 262       | MPa             | Ultimate    | T3.3(A)  |
|                                   | $F_{ty}$                     | = 241       | MPa             | Yield       |          |
| Compression                       | $F_{cy}$                     | = 241       | MPa             |             |          |
| Shear                             | $F_{su}$                     | = 165       | MPa             | Ultimate    |          |
|                                   | $F_{sy}$                     | = 138       | MPa             | Yield       |          |
| Bearing                           | $F_{bu}$                     | = 551       | MPa             | Ultimate    |          |
|                                   | $F_{by}$                     | = 386       | MPa             | Yield       |          |
| Modulus of elasticity             | E                            | = 70000     | MPa             | Compressive |          |
|                                   | $k_t$                        | = 1.0       |                 |             | T3.4(B)  |
|                                   | $k_c$                        | = 1.0       |                 |             |          |
| <b>FEM ANALYSIS RESULTS</b>       |                              |             |                 |             |          |
| Axial force                       | P                            | = 1.28      | kN              | compression |          |
| In plane moment                   | $M_x$                        | = 0.46      | kNm             |             |          |
| Out of plane moment               | $M_y$                        | = 0.07      | kNm             |             |          |
| <b>DESIGN STRESSES</b>            |                              |             |                 |             |          |
| Gross cross section area          | $A_g$                        | = 304       | mm <sup>2</sup> |             |          |
| In-plane elastic section modulus  | $Z_x$                        | = 3668.2667 | mm <sup>3</sup> |             |          |
| Out-of-plane elastic section mod. | $Z_y$                        | = 3668.2667 | mm <sup>3</sup> |             |          |
| Stress from axial force           | $f_a$                        | = $P/A_g$   |                 |             |          |



## Civil & Structural Engineering Design Services Pty. Ltd.

|                                                                                                               |             |   |            |                   |              |
|---------------------------------------------------------------------------------------------------------------|-------------|---|------------|-------------------|--------------|
| Stress from in-plane bending                                                                                  | $f_{bx}$    | = | 4.21 MPa   | compression       |              |
|                                                                                                               |             | = | $M_x/Z_x$  |                   |              |
| Stress from out-of-plane bending                                                                              | $f_{by}$    | = | 125.40 MPa | compression       |              |
|                                                                                                               |             | = | $M_y/Z_y$  |                   |              |
|                                                                                                               |             | = | 19.08 MPa  | compression       |              |
| <b>COMPRESSION</b>                                                                                            |             |   |            |                   |              |
| <b>3.4.8 Compression in columns, axial, gross section</b>                                                     |             |   |            |                   |              |
| <b>1. General</b>                                                                                             |             |   |            |                   | ... 3.4.8.1  |
| Unsupported length of member                                                                                  | L           | = | 3000 mm    |                   |              |
| Effective length factor                                                                                       | k           | = | 1          |                   |              |
| Radius of gyration about buckling axis                                                                        | r           | = | 15.53 mm   |                   |              |
| Slenderness ratio                                                                                             | $kL/r$      | = | 193.11     |                   |              |
| Slenderness parameter                                                                                         | $\lambda$   | = | 3.61       |                   |              |
|                                                                                                               | $D_c^*$     | = | 90.3       |                   |              |
|                                                                                                               | $S_1^*$     | = | 0.33       |                   |              |
|                                                                                                               | $S_2^*$     | = | 1.23       |                   |              |
|                                                                                                               | $\phi_{cc}$ | = | 0.950      |                   |              |
| Factored limit state stress                                                                                   | $\phi F_L$  | = | 17.60 MPa  |                   |              |
| <b>2. Sections not subject to torsional or torsional-flexural buckling</b>                                    |             |   |            |                   | ... 3.4.8.2  |
| Largest slenderness ratio for flexural buckling                                                               | $kL/r$      | = | 193.11     |                   |              |
| <b>3.4.10 Uniform compression in components of columns, gross section - flat plates</b>                       |             |   |            |                   |              |
| <b>1. Uniform compression in components of columns, gross section - flat plates with both edges supported</b> |             |   |            |                   | ... 3.4.10.1 |
|                                                                                                               | $k_1$       | = | 0.35       |                   | T3.3(D)      |
| Max. distance between toes of fillets of supporting elements for plate                                        | $b'$        | = | 36         |                   |              |
|                                                                                                               | t           | = | 2 mm       |                   |              |
| Slenderness                                                                                                   | $b/t$       | = | 18         |                   |              |
| Limit 1                                                                                                       | $S_1$       | = | 12.34      |                   |              |
| Limit 2                                                                                                       | $S_2$       | = | 32.87      | $S_1 < b/t < S_2$ |              |
| Factored limit state stress                                                                                   | $\phi F_L$  | = | 213.07 MPa |                   |              |



## Civil & Structural Engineering Design Services Pty. Ltd.

|                                                                                                                                               |                 |   |          |                 |                 |           |
|-----------------------------------------------------------------------------------------------------------------------------------------------|-----------------|---|----------|-----------------|-----------------|-----------|
| Most adverse compressive limit state stress                                                                                                   | $F_a$           | = | 17.60    | MPa             |                 |           |
| Most adverse compressive capacity factor                                                                                                      | $f_a/F_a$       | = | 0.24     |                 | PASS            |           |
| <b>BENDING - IN-PLANE</b>                                                                                                                     |                 |   |          |                 |                 |           |
| <b>3.4.15</b> Compression in beams, extreme fibre, gross section rectangular tubes, box sections                                              |                 |   |          |                 |                 |           |
| Unbraced length for bending                                                                                                                   | $L_b$           | = | 3000     | mm              |                 |           |
| Second moment of area (weak axis)                                                                                                             | $I_y$           | = | 73365.33 | mm <sup>4</sup> |                 |           |
| Torsion modulus                                                                                                                               | $J$             | = | 109744   | mm <sup>3</sup> |                 |           |
| Elastic section modulus                                                                                                                       | $Z$             | = | 3668.266 | mm <sup>3</sup> |                 |           |
| Slenderness                                                                                                                                   | $S$             | = | 245.29   |                 |                 |           |
| Limit 1                                                                                                                                       | $S_1$           | = | 0.39     |                 |                 |           |
| Limit 2                                                                                                                                       | $S_2$           | = | 1695.86  |                 | $S_1 < S < S_2$ |           |
| Factored limit state stress                                                                                                                   | $\phi F_L$      | = | 194.46   | MPa             |                 | 3.4.15(2) |
| <b>3.4.17</b> Compression in components of beams (component under uniform compression), gross section - flat plates with both edges supported |                 |   |          |                 |                 |           |
|                                                                                                                                               | $k_1$           | = | 0.5      |                 |                 | T3.3(D)   |
|                                                                                                                                               | $k_2$           | = | 2.04     |                 |                 | T3.3(D)   |
| Max. distance between toes of fillets of supporting elements for plate                                                                        | $b'$            | = | 36       | mm              |                 |           |
|                                                                                                                                               | $t$             | = | 2        | mm              |                 |           |
| Slenderness                                                                                                                                   | $b/t$           | = | 18       |                 |                 |           |
| Limit 1                                                                                                                                       | $S_1$           | = | 12.34    |                 |                 |           |
| Limit 2                                                                                                                                       | $S_2$           | = | 46.95    |                 | $S_1 < S < S_2$ |           |
| Factored limit state stress                                                                                                                   | $\phi F_L$      | = | 213.07   | MPa             |                 |           |
| Most adverse in-plane bending limit state stress                                                                                              | $F_{bx}$        | = | 194.46   | MPa             |                 |           |
| Most adverse in-plane bending capacity factor                                                                                                 | $f_{bx}/F_{bx}$ | = | 0.64     |                 | PASS            |           |
| <b>BENDING - OUT-OF-PLANE</b>                                                                                                                 |                 |   |          |                 |                 |           |





## Civil & Structural Engineering Design Services Pty. Ltd.

NOTE: Limit state stresses,  $\phi F_L$  are the same for out-of-plane bending (doubly symmetric section)

Factored limit state stress  $\phi F_L = 194.46$  MPa

Most adverse out-of-plane bending limit state stress  $F_{by} = 194.46$  MPa

Most adverse out-of-plane bending capacity factor  $f_{by}/F_{by} = 0.10$

PASS

### COMBINED ACTIONS

#### 4.1.1 Combined compression and bending

$F_a = 17.60$  MPa

$F_{ao} = 213.07$  MPa

$F_{bx} = 213.07$  MPa

$F_{by} = 194.46$  MPa

$f_a/F_a = 0.239$

Check:  $f_a/F_a + f_{bx}/F_{bx} + f_{by}/F_{by} \leq 1.0$

i.e.  $0.98 \leq 1.0$

Which is  $< 0.15$

PASS

... 4.1.1(2)

... 3.4.8

... 3.4.10

... 3.4.17

... 3.4.17

... 4.1.1 (3)

### 6.7 Cross Brace

| NAME                  | SYMBOL         | VALUE   | UNIT | NOTES       | REF      |
|-----------------------|----------------|---------|------|-------------|----------|
| <b>40x40x2</b>        | <b>(Brace)</b> |         |      |             |          |
| Alloy and temper      | 6061-T6        |         |      |             | AS1664.1 |
| Tension               | $F_{tu}$       | = 262   | MPa  | Ultimate    | T3.3(A)  |
|                       | $F_{ty}$       | = 241   | MPa  | Yield       |          |
| Compression           | $F_{cy}$       | = 241   | MPa  |             |          |
| Shear                 | $F_{su}$       | = 165   | MPa  | Ultimate    |          |
|                       | $F_{sy}$       | = 138   | MPa  | Yield       |          |
| Bearing               | $F_{bu}$       | = 551   | MPa  | Ultimate    |          |
|                       | $F_{by}$       | = 386   | MPa  | Yield       |          |
| Modulus of elasticity | E              | = 70000 | MPa  | Compressive |          |
|                       | $k_t$          | = 1.0   |      |             | T3.4(B)  |
|                       | $k_c$          | = 1.0   |      |             |          |
| FEM ANALYSIS RESULTS  |                |         |      |             |          |



## Civil & Structural Engineering Design Services Pty. Ltd.

|                                                                                                               |             |   |              |                 |             |              |
|---------------------------------------------------------------------------------------------------------------|-------------|---|--------------|-----------------|-------------|--------------|
| Axial force                                                                                                   | $P$         | = | 1.3          | kN              | compression |              |
| In plane moment                                                                                               | $M_x$       | = | 0.08         | kNm             |             |              |
| Out of plane moment                                                                                           | $M_y$       | = | 0.08         | kNm             |             |              |
| <b>DESIGN STRESSES</b>                                                                                        |             |   |              |                 |             |              |
| Gross cross section area                                                                                      | $A_g$       | = | 304          | mm <sup>2</sup> |             |              |
| In-plane elastic section modulus                                                                              | $Z_x$       | = | 3668.2667    | mm <sup>3</sup> |             |              |
| Out-of-plane elastic section mod.                                                                             | $Z_y$       | = | 3668.2667    | mm <sup>3</sup> |             |              |
| Stress from axial force                                                                                       | $f_a$       | = | $P/A_g$      |                 | compression |              |
|                                                                                                               |             | = | <b>4.28</b>  | <b>MPa</b>      |             |              |
| Stress from in-plane bending                                                                                  | $f_{bx}$    | = | $M_x/Z_x$    |                 | compression |              |
|                                                                                                               |             | = | <b>21.81</b> | <b>MPa</b>      |             |              |
| Stress from out-of-plane bending                                                                              | $f_{by}$    | = | $M_y/Z_y$    |                 | compression |              |
|                                                                                                               |             | = | <b>21.81</b> | <b>MPa</b>      |             |              |
| <b>COMPRESSION</b>                                                                                            |             |   |              |                 |             |              |
| <b>3.4.8 Compression in columns, axial, gross section</b>                                                     |             |   |              |                 |             |              |
| <b>1. General</b>                                                                                             |             |   |              |                 |             |              |
| Unsupported length of member                                                                                  | $L$         | = | 4000         | mm              |             | ... 3.4.8.1  |
| Effective length factor                                                                                       | $k$         | = | 1            |                 |             |              |
| Radius of gyration about buckling axis                                                                        | $r$         | = | 15.53        | mm              |             |              |
| Slenderness ratio                                                                                             | $kL/r$      | = | 257.48       |                 |             |              |
| Slenderness parameter                                                                                         | $\lambda$   | = | 4.81         |                 |             |              |
|                                                                                                               | $D_c^*$     | = | 90.3         |                 |             |              |
|                                                                                                               | $S_1^*$     | = | 0.33         |                 |             |              |
|                                                                                                               | $S_2^*$     | = | 1.23         |                 |             |              |
|                                                                                                               | $\phi_{cc}$ | = | 0.950        |                 |             |              |
| Factored limit state stress                                                                                   | $\phi F_L$  | = | <b>9.90</b>  | <b>MPa</b>      |             |              |
| <b>2. Sections not subject to torsional or torsional-flexural buckling</b>                                    |             |   |              |                 |             |              |
| Largest slenderness ratio for flexural buckling                                                               | $kL/r$      | = | 257.48       |                 |             | ... 3.4.8.2  |
| <b>3.4.10 Uniform compression in components of columns, gross section - flat plates</b>                       |             |   |              |                 |             |              |
| <b>1. Uniform compression in components of columns, gross section - flat plates with both edges supported</b> |             |   |              |                 |             |              |
|                                                                                                               |             |   |              |                 |             | ... 3.4.10.1 |



## Civil & Structural Engineering Design Services Pty. Ltd.

|                                                                                                                                                      |            |   |           |                 |                 |           |
|------------------------------------------------------------------------------------------------------------------------------------------------------|------------|---|-----------|-----------------|-----------------|-----------|
|                                                                                                                                                      | $k_1$      | = | 0.35      |                 |                 | T3.3(D)   |
| Max. distance between toes of fillets of supporting elements for plate                                                                               | $b'$       | = | 36        |                 |                 |           |
|                                                                                                                                                      | $t$        | = | 2         | mm              |                 |           |
| Slenderness                                                                                                                                          | $b/t$      | = | 18        |                 |                 |           |
| Limit 1                                                                                                                                              | $S_1$      | = | 12.34     |                 |                 |           |
| Limit 2                                                                                                                                              | $S_2$      | = | 32.87     |                 | $S1 < b/t < S2$ |           |
| Factored limit state stress                                                                                                                          | $\phi F_L$ | = | 213.07    | MPa             |                 |           |
| Most adverse compressive limit state stress                                                                                                          | $F_a$      | = | 9.90      | MPa             |                 |           |
| Most adverse compressive capacity factor                                                                                                             | $f_a/F_a$  | = | 0.43      |                 | PASS            |           |
| <b>BENDING - IN-PLANE</b>                                                                                                                            |            |   |           |                 |                 |           |
| <b>3.4.15</b> <i>Compression in beams, extreme fibre, gross section rectangular tubes, box sections</i>                                              |            |   |           |                 |                 |           |
| Unbraced length for bending                                                                                                                          | $L_b$      | = | 4000      | mm              |                 |           |
| Second moment of area (weak axis)                                                                                                                    | $I_y$      | = | 73365.333 | mm <sup>4</sup> |                 |           |
| Torsion modulus                                                                                                                                      | $J$        | = | 109744    | mm <sup>3</sup> |                 |           |
| Elastic section modulus                                                                                                                              | $Z$        | = | 3668.2667 | mm <sup>3</sup> |                 |           |
| Slenderness                                                                                                                                          | $S$        | = | 327.05    |                 |                 |           |
| Limit 1                                                                                                                                              | $S_1$      | = | 0.39      |                 |                 |           |
| Limit 2                                                                                                                                              | $S_2$      | = | 1695.86   |                 | $S1 < S < S2$   |           |
| Factored limit state stress                                                                                                                          | $\phi F_L$ | = | 188.90    | MPa             |                 | 3.4.15(2) |
| <b>3.4.17</b> <i>Compression in components of beams (component under uniform compression), gross section - flat plates with both edges supported</i> |            |   |           |                 |                 |           |
|                                                                                                                                                      | $k_1$      | = | 0.5       |                 |                 | T3.3(D)   |
|                                                                                                                                                      | $k_2$      | = | 2.04      |                 |                 | T3.3(D)   |
| Max. distance between toes of fillets of supporting elements for plate                                                                               | $b'$       | = | 36        | mm              |                 |           |
|                                                                                                                                                      | $t$        | = | 2         | mm              |                 |           |
| Slenderness                                                                                                                                          | $b/t$      | = | 18        |                 |                 |           |
| Limit 1                                                                                                                                              | $S_1$      | = | 12.34     |                 |                 |           |
| Limit 2                                                                                                                                              | $S_2$      | = | 46.95     |                 | $S1 < S < S2$   |           |



## Civil & Structural Engineering Design Services Pty. Ltd.

|                                                                                                                           |                                                    |        |        |     |                |               |
|---------------------------------------------------------------------------------------------------------------------------|----------------------------------------------------|--------|--------|-----|----------------|---------------|
| Factored limit state stress                                                                                               | $\phi F_L$                                         | =      | 213.07 | MPa |                |               |
| Most adverse in-plane bending limit state stress                                                                          | $F_{bx}$                                           | =      | 188.90 | MPa |                |               |
| Most adverse in-plane bending capacity factor                                                                             | $f_{bx}/F_{bx}$                                    | =      | 0.12   |     | PASS           |               |
| <b>BENDING - OUT-OF-PLANE</b>                                                                                             |                                                    |        |        |     |                |               |
| <i>NOTE: Limit state stresses, <math>\phi F_L</math> are the same for out-of-plane bending (doubly symmetric section)</i> |                                                    |        |        |     |                |               |
| Factored limit state stress                                                                                               | $\phi F_L$                                         | =      | 188.90 | MPa |                |               |
| Most adverse out-of-plane bending limit state stress                                                                      | $F_{by}$                                           | =      | 188.90 | MPa |                |               |
| Most adverse out-of-plane bending capacity factor                                                                         | $f_{by}/F_{by}$                                    | =      | 0.12   |     | PASS           |               |
| <b>COMBINED ACTIONS</b>                                                                                                   |                                                    |        |        |     |                |               |
| <b>4.1.1 Combined compression and bending</b>                                                                             |                                                    |        |        |     |                |               |
|                                                                                                                           | $F_a$                                              | =      | 9.90   | MPa |                | 4.1.1(2)      |
|                                                                                                                           | $F_{ao}$                                           | =      | 213.07 | MPa |                | ... 3.4.8     |
|                                                                                                                           | $F_{bx}$                                           | =      | 213.07 | MPa |                | ... 3.4.10    |
|                                                                                                                           | $F_{by}$                                           | =      | 188.90 | MPa |                | ... 3.4.17    |
|                                                                                                                           | $f_a/F_a$                                          | =      | 0.432  |     | Which is <0.15 | ... 3.4.17    |
| Check:                                                                                                                    | $f_a/F_a + f_{bx}/F_{bx} + f_{by}/F_{by} \leq 1.0$ |        |        |     |                | ... 4.1.1 (3) |
| i.e.                                                                                                                      | 0.66                                               | $\leq$ | 1.0    |     | PASS           |               |



## Civil & Structural Engineering Design Services Pty. Ltd.

### 7 Summary

#### 7.1 Conclusions

- a. The 9m Span x 3m Bay Function Crest Standard Tent structure as specified has been analyzed with a conclusion that it has the capacity to withstand wind speeds up to and including **80km/hr**.
- b. For forecast winds in excess of **80km/hr** – all fabric shall be removed from the frames, and the structure should be completely dismantled.
- c. Wall Bracing and roof bracing are required at each end bay and every third bay in between to resist against lateral movement due to wind direction<sup>2</sup> for multiple tent length.(refer to detail drawing)
- d. Bracing cables are required to have minimum tensile strength equal to 6 kN.
- e. For uplift due to 80km/hr, 3.5 kN (350Kg) holding down weight/per leg is required.
- f. The bearing pressure of soil should be clarified and checked by an engineer prior to any construction for considering foundation and base plate.
- g. Required Weight per leg for smaller tents:



| Span Width | Required Weight Per Leg |      |
|------------|-------------------------|------|
|            | (kN)                    | (Kg) |
| 6          | 3                       | 300  |
| 8          | 3.2                     | 320  |
| 9          | 3.5                     | 350  |

Yours faithfully,


E.A. Bennett M.I.E. Aust. NPER 198230



8 Appendix A – 9m x 9m Function Crest Tent

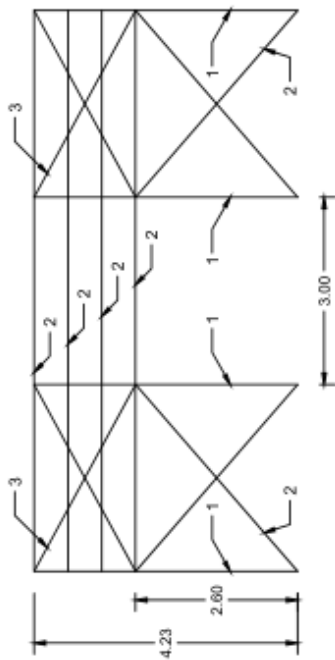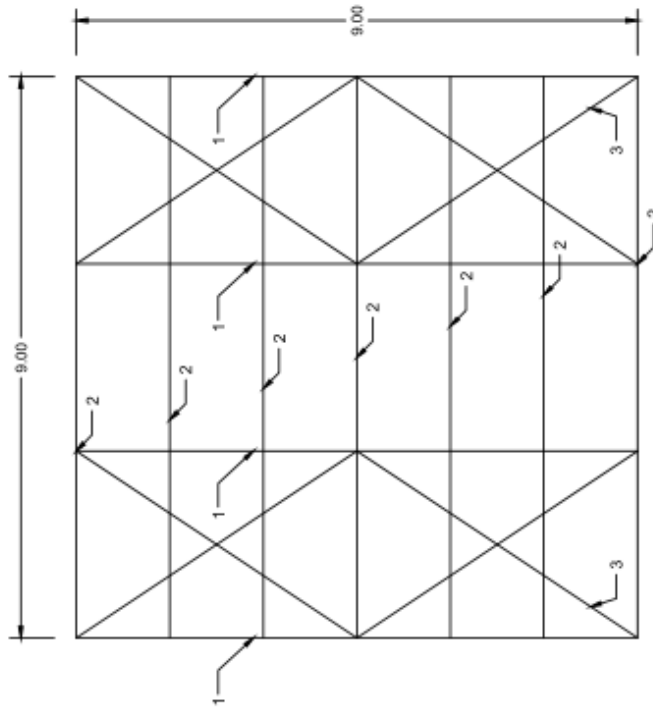

SIDE ELEVATION  
1 : 100

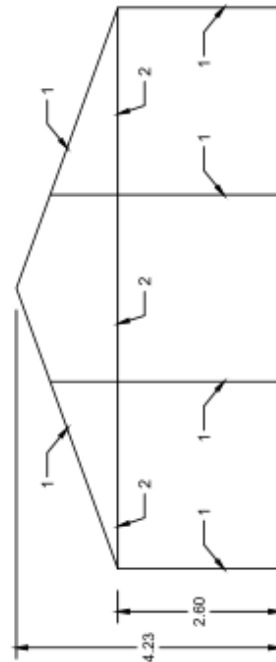

END ELEVATION  
1 : 100

| ALUMINUM PROFILE SCHEDULE |                                                                 |         |
|---------------------------|-----------------------------------------------------------------|---------|
| 1                         | RAFTER, UPRIGHT SUPPORT<br>GABLE POLE                           | 82X48X3 |
| 2                         | EAVE, RIDGE &<br>INTERMEDIATE PURLIN<br>GABLE BEAM, CROSS BRACE | 40X40X2 |
| 3                         | ROOF CABLE                                                      | D6      |